

Poon, Peter

From: Andy Cintron <acintron@cityofbutler.in.gov>
Sent: Wednesday, January 21, 2026 8:23 AM
To: Poon, Peter
Cc: Seyer, Emma
Subject: Re: Butler Water Dept. (5217003): Disinfection By-Products Sampling Locations
Attachments: TTHM-HAA5 form.pdf; Butler-IN-Water-Assets-Water-Main.kml; Butler-IN-Water-Assets-IDEM-Sampling-Site.kml

EXTERNAL EMAIL: This email was sent from outside your organization. Exercise caution when clicking links, opening attachments or taking further action, before validating its authenticity.

I'm proposing a change of the current 695 East Green THM1 site be moved to 603 E green and the HAA5 to 510 W Main. My hope is to stay on the reduced monitoring and sample both TTHM and HAA5 at the 603 E Green location.

Please let me know if the KML file files can be open and viewed on your end. I don't have the capabilities on my computer to open/view them once created.

Thank you. Let me know if you have any questions.

Andy Cintron
Water Superintendent
141 Willow Street
Butler, IN 46721
260-868-2075

"When the well is dry, we know the worth of water." - Benjamin Franklin

From: Poon, Peter <PPoon@idem.IN.gov>
Sent: Wednesday, December 3, 2025 3:54 PM
To: Andy Cintron <acintron@cityofbutler.in.gov>
Cc: Seyer, Emma <ESeyer@idem.IN.gov>; Andrews, Sophia J <SoAndrew@idem.IN.gov>
Subject: RE: Butler Water Dept. (5217003): Disinfection By-Products Sampling Locations

Andy,

Butler Water Department is currently on the reduced* DBP monitoring schedule:

- 1 TTHM and 1 HAA5 sample every August collected from Site *HAA-1* (695 East Green)

*Site *THM-1* (103 Basket Factory) is for DBP sampling in the event that Butler Water Department returns to the routine DBP monitoring schedule (2 TTHM and 2 HAA5 every August)

If you need to change the current sample location (Site *HAA-1*), you will need to choose a location that is close enough to 695 East Green in order to be able to stay on the reduced monitoring schedule. If the new location is not close to the old location, you will have to return to the routine DBP monitoring schedule (2 TTHM and 2 HAA5 every year in August) for at least 1 year.

If you still want to change the sample location, fill out the attached Stage 2 DBP Compliance Monitoring Plan and submit a distribution map showing the 695 East Green (Site HAA-1) and 103 Basket Factory (Site THM-1) and the proposed replacement for 695 East Green. I will review the plan and map and let you know if it is approved.



Peter Poon, P.E.
Environmental Engineer
Drinking Water Branch

(317) 234-7441 • PPoon@idem.IN.gov

     | www.idem.IN.gov

Scan the QR code to leave your feedback.

We appreciate your input!



Visit the Drinking Water Viewer website (<https://indwv.gecsws.com>) to view sampling results and up-to-date sampling requirements.

From: Andrews, Sophia J <SoAndrew@idem.IN.gov>
Sent: Wednesday, December 3, 2025 3:35 PM
To: Poon, Peter <PPoon@idem.IN.gov>
Cc: acintron@cityofbutler.in.gov; Seyer, Emma <ESeyer@idem.IN.gov>
Subject: Butler Water Dept. (5217003): Disinfection By-Products Sampling Locations


Hello, Peter.

Emma and I were onsite at this facility yesterday. The water Superintendent is Andy Cintron (copied), and he is interested in changing one of his sampling locations. I told him I would put him in touch with you.

Thanks,

Sophia Andrews
Drinking Water Inspector, Northern Regional Office
Indiana Department of Environmental Management
300 North Dr. Martin Luther King Jr., Boulevard, Suite 211
South Bend, IN 46601

(574) 274-5610 • SoAndrew@idem.in.gov

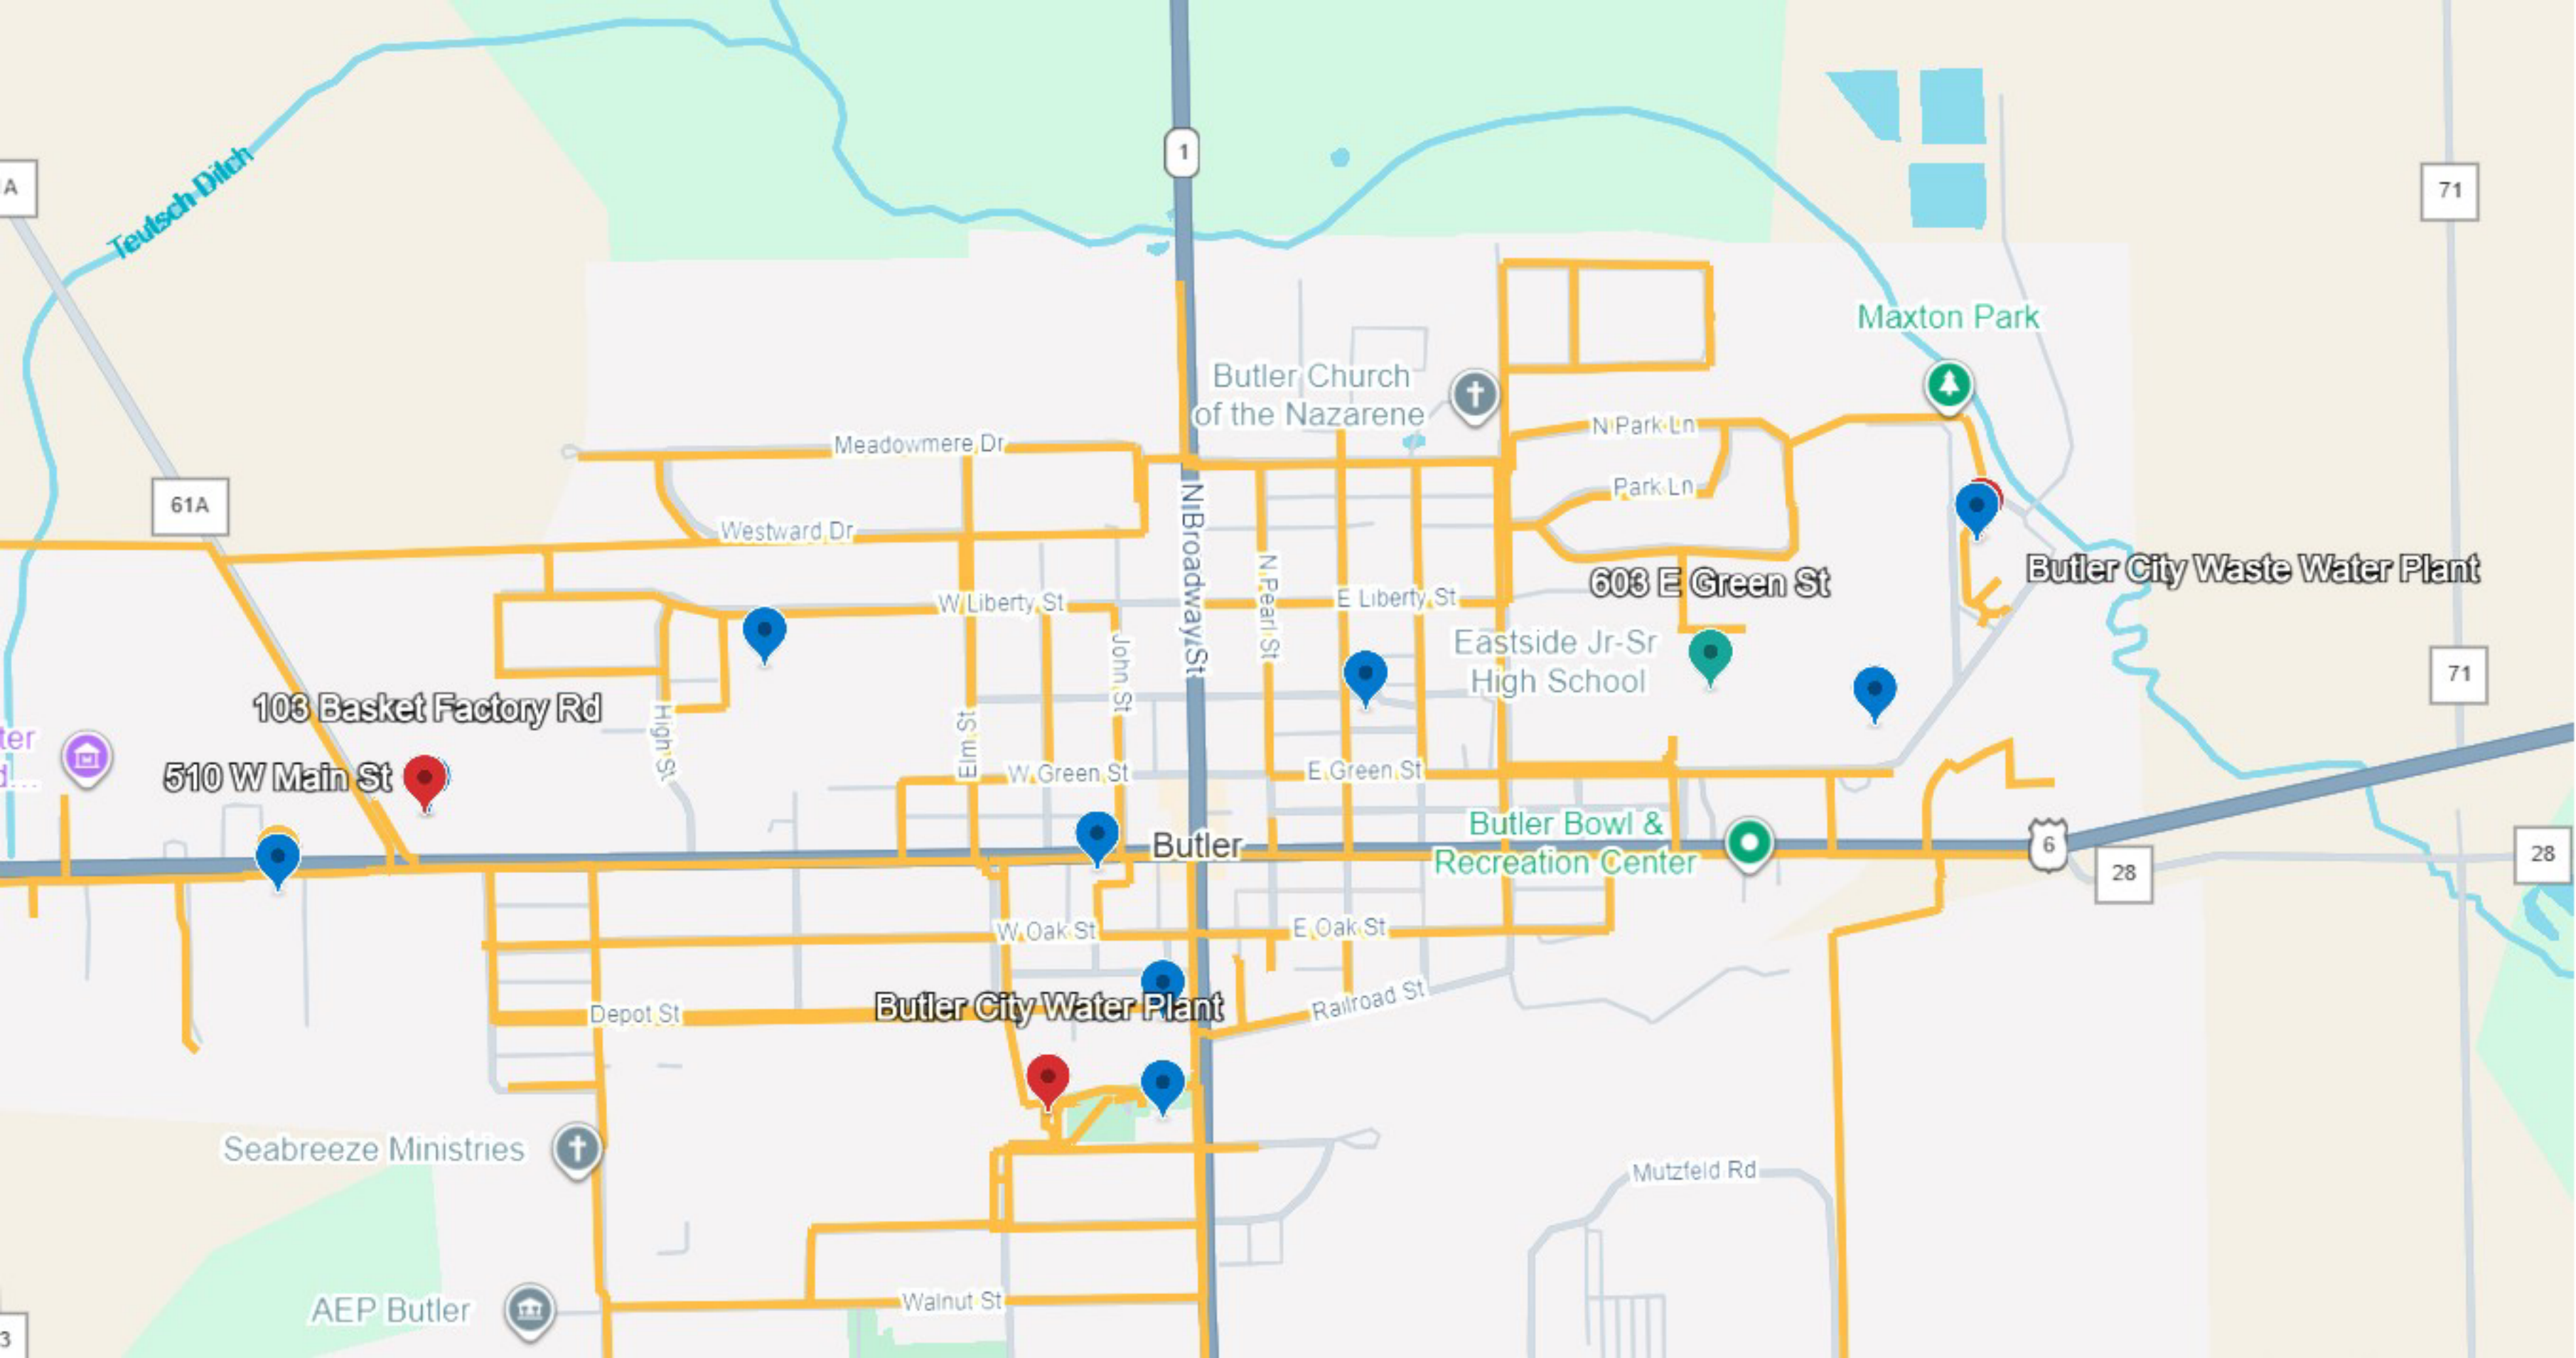

Teutsch Ditch

71

Maxton Park

Butler Church of the Nazarene

61A

Meadowmere Dr

N Park Ln

Westward Dr

Park Ln

Butler City Waste Water Plant

603 E Green St

71

103 Basket Factory Rd

W Liberty St

E Liberty St

Eastside Jr-Sr High School

510 W Main St

High St

Elm St

John St

W Green St

E Green St

Butler

Butler Bowl & Recreation Center

6

28

28

W Oak St

E Oak St

Butler City Water Plant

Railroad St

Seabreeze Ministries

Mutzfeld Rd

AEP Butler

Walnut St