## Piping Secondary Containment Integrity Testing

### CBD Service LLC Fort Wayne, IN 46809 260-433-6232

Facility Name:	: Stop on the Way # 27			Owner:				
Address:	: 4933 Lima Rd.			Address:				
City, State, Zip:	: Fort Wayne, IN 46808		Cit	y, State, Zip:				
Phone:	260-484-8887			Facility ID#:				
Testing Company:	CBD	O Service LLC		Date:		1/2/2024		
This procedure is to test the integrity of the	interstitial space of	the double-walled p	iping. See	PEI/RP1200	Section 5 for the te	st procedure.		
Tank Number	1	1	2		2	3		
Piping Run	stp, 13/14, 9/10, 5/6, 1/2	stp, 15/16, 11/12, 7/8, 3/4	stp, 13/14, 9/10, 5/6, 1/2		stp, 15/16, 11/12, 7/8, 3/4	stp, 15/16, 11/12, 7/8, 3/4		
Piping Material	poly	poly	poly		poly	poly		
Product Stored	unleaded	unleaded	premium		premium	diesel		
Test Start Time	8:00 AM	8:00 AM	9:10 AM		9:10 AM	10:20 AM		
Initial Test Pressure (PSIG) (test procedure specifies 5 psig)	6	6	6		6	6		
Test End Time	9:00 AM	9:00 AM	10:10 AM		10:10 AM	11:20 AM		
Final Test Pressure (psig)	6	6	6		6	6		
Pressure Change	0	0	0		0	0		
Test results	pass	pass	pa	iss	pass	pass		

Comments:

Tester Signature:

UST

Liscense #:

UC2019OH13010











Facility Details
Get 2 Go
Get 2 Go 27 - 69 & Lima Rd.
4933 Lima Rd.
Fort Wayne, IN 46808
2604848887
State ID#: IN

# PEI/RP1200 UST Overfill Equipment Inspection Automatic Shutoff Device and Ball Float Valve

**Completed September 26, 2022** 

Owner Details	Facility Details				
Get 2 Go	Get 2 Go 27 - 69 & Lima Rd.				
3505 Wayne Trace	Main System				
Fort Wayne, IN 46806	4933 Lima Rd.				
2604477648	Fort Wayne, IN, 46808				
	2604848887				
	State ID#:IN				

#### **Chris Dunifon**

Inspector's Printed Name

Inspector's Signature

MB Fall

### **APPENDIX C-5**

UST OVERFILL EQUIPMENT INSPECTION AUTOMATIC SHUTOFF DEVICE AND BALL FLOAT VALVE								
Facility Name: Get 2 Go		Owner: Get 2 Go						
Address: 4933 Lima Rd.	Address: 3505 Wayne Trace							
City, State, Zip Code: Fort Wayne, IN 46808			City, State, Zip Code: Fort Wayne, IN 46806					
Facility I.D. #: IN	•		Phone #:2604	Phone #:2604477648				
Testing Company: Gasoline Ed	uipment		Phone #: 2607	475088	Date: 09-26-2	2022		
This data sheet is for inspecting automatic shutoff devices and ball float valves. See PEI/RP1200, Section 7 for inspection procedures.								
Product Grade	Unleaded	Premium	Diesel					
Tank Number	1	2	3					
Tank Volume, gallons	11595	7796	9696					
Tank Diameter, inches	92	92	92					
Overfill Prevention Device Brand	NA	NA	NA					
Туре	■ Automatic Shutoff Device ■ Ball Float Valve	■ Automatic Shutoff Device ■ Ball Float Valve	■ Automatic Shutoff Device ■ Ball Float Valve	☐ Automatic Shutoff Device ☐ Ball Float Valve	□ Automatic Shutoff Device □ Ball Float Valve	■ Automatic Shutoff Device ■ Ball Float Valve		
AUTOMATIC SHUTOFF DEVICE II	NSPECTION							
1. Drop tube removed from tank?	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No		
Drop tube and float mechanisms are free of debris?	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No		
3. Float moves freely without binding and poppet moves into flow path?	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No		
4. Bypass valve in the drop tube is open and free of blockage (if present)?	☐ Yes ☐ No☐ Not Present	☐ Yes ☐ No ☐ Not Present	Yes No	☐Yes ☐No ☐Not Present	Yes No	Yes No Not Present		
5. Flapper is adjusted to shut off flow at 95% capacity?*	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No		
A "No" to any item in Lines 1-5 inc	licates a test failu	ıre.						
BALL FLOAT VALVE INSPECTION								
1. Tank top fittings are vaportight and leak-free?	☑Yes ☐No	☑Yes ☐No	☑Yes ☐No	□Yes □No	□Yes □No	☐Yes ☐No		
2 Ball float cage free of debris?	☑Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No	☐Yes ☐No		
3. Ball is free of holes and cracks and moves freely in cage?	☑Yes ☐No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	Yes here		
4. Vent hole in pipe is open and near top of tank?	☑Yes ☐No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No		
5. Ball float pipe is proper length to restrict flow at 90% capacity?**	☑Yes ☐No	□Yes □No	□Yes □No	□Yes □No	□Yes □No	□Yes □No		
A "No" to any item in Lines 1-5 indicates a test failure.								
Test Results		☐ Pass ☐ Fail						
* Use manufacturer's suggested procedure for determining if automatic shutoff device will shut off flow at 95% capacity.  ** Use manufacturer's suggested procedure for determining if flow restriction device will restrict flow at 90% capacity.								
Comments: Unable to remove Diesel ball float due to bar breaking off during removal process. cannot be replaired, needs replac								

# UST Overfill Equipment Inspection Automatic Shutoff Device and Ball Float Valve

### CBD Service LLC Fort Wayne, IN 46809 260-433-6232

Facility Name:	: Stop on the Way # 27		Owner:				
Address:	4933 Lima Rd.		Address:				
City, State, Zip:	Fort Wayne, IN 46	808	City, State, Zip:				
Phone:	260-484-8887		Facility ID:				
Testing Company:	CBD Servic	e LLC		Phone #: 3-6232	Date:	Date: 1/2/2024	
This data sheet is for inspecti	ing automatic shutoff devi	ices and ball float	valves. See PEI/R	P1200, Section 71	for inspection pro	ocedures.	
Tank Number		2					
Product		premium					
Tank Volume		7796					
Tank Diameter, inche	25	91.6					
Overfill Prevention D	evice Brand						
Туре	Туре						
		Automa	atic Shutoff D	evice			
1. Drop tube removed	from tank? y/n						
2. Drop Tube and float medebris? y/n	echanisms are free of						
3. Float moves freely with poppet moves into flow p							
4. Bypass valve in the dro	-						
free of debris? y/n/na  5. Flapper is adjusted to s	but off flow at 05%						
capacity?	nut on now at 95%						
A "no" to any item in	lines 1-5 indicates	a test failure	2.				•
		Ва	ıll Float Valve	)			
1. Tank top fittings are vapor tight and leak free? y/n		yes					
2. Ball float cage free of debris? y/n		yes					
3. Ball is free of holes and freely in cage? y/n	cracks and moves	yes					
4. Vent hole in pipe is open and near top of tank? y/n		yes					
5. Ball float pipe is proper length to restrict flow at 95% capacity? y/n		yes					
A "no" to any item in	lines 1-5 indicates	a test failure	e.			-	-
Test Results		pass					

Comments:

Tester Signature:	Chr Puf
UST License #:	UC2019OH13010

# **Liquid Sensor Functionality Test**

### CBD Service LLC Fort Wayne, IN 46809 260-433-6232

Facility Name:	Stop on the Way # 20		Owner:						
Address:	5938 Lima Rd.		Address:						
City, State, Zip:	For	t Wayne, IN 46	808	City, State, Zip:					
Phone:		260-489-0071		Facility ID #:					
Testing Company:	CBD Service LLC			Tester Phone #: 260-433-6232		Date:	1/3/	1/3/2024	
Sensor Location	interstitial								
Product Stored	unlead, prem, diesel								
Type of Sensor	non- discriminating								
Test Liquid	water								
Is the ATG console clear of any active alarms reguarding the leak sensor? y/n If the sensor is in alarm and functioning indcate why.	yes								
Is the sensor alarm circuit operational? y/n	yes								
Has sensor been inspected and in good operating condition? y/n	yes								
When placed in the test liquid, doed the sensor trigger an alarm? y/n	yes								
When an alarm is triggered, is the sensor properly identified on the ATG console? y/n	yes								
Test Results	pass								

Comments:

Tester Signature: UST

Liscense #:

UC2019OH13010

100 North Senate Ave Indianapolis, Indiana, 46204 (800) 451-6027 . (317) 232-8603 www.idem.IN.gov

## Certificate of Completion

Awarded to: charanjit singh

For completion of IDEM's Underground Storage Tank "B" Operator Training in accordance with 329 IAC 9.

License #: 21908

Issue Date: February 20, 2023

Expiration Date: February 20, 2026

Brian C. Rockensuess, Commissioner

IDEM may require operator retraining if a UST System managed by the operator has documented deficiencies per 329 IAC 9.

## **CBD Service LLC**

5015 Meadow Ln, Fort Wayne, IN 46809

260-433-6232, chrisdunifon@gmail.com

**Quote # Q133** 

We are pleased to offer the following quotation.

The undersigned purposes to furnish all materials and perform all labor necessary to complete the following:

Supply labor, material and equipment to inspect, prepare and install an internal liner in (1) UST approximately 8,000 gallon.

#### Tank Inspection

- 1. Travel to Stop One Way #27 Shell 4923 Lima Rd. Ft. Wayne, IN with two trucks, air compressor and trailer.
- 2. Clean tanks removing product and sludge, then spread dry all to absorb any petroleum bae product base product and remove all waste.
- 3. Visually inspect (1) fiberglass tank looking for stars, condition of internal coating and other indicators showing condition of tank
- 4. Take deflection readings horizontally, vertically and diagonally
- 5. Complete tank reports including pictures, findings and recommendations

\$6,250.00

#### Lining Installation

Prepare tank for lining and install an internal lining on (1) UST approximately 10,000 gal. (lining is not for structural purposes)

- 1. Sand surface throughout tank prepping surface for lining, wipe the tank surface down and vacuum preparing tank for liner.
- 2. Using a fiberglass matt and fiberglass gel, repair low spots throughout the tank surface
- 3. Spray liner (Enviroline 376F-30) first in the seems, all the low areas and throughout the surface at no less than 20 mils, working to get a even coat throughout tank
- 4. Perform lining hardness and thickness tests based on manufacture recommendations \$9,500.00

Total: \$15,750.00

- Special Notes:
  1. Lining is not for structural purposes
  2. Quote is based on scope alone, any additional will be at T&M.
  3. 20% must be paid before work begins
  4. If, a high water table is found a frac tank must be supplied for de watering

#### Williams, Beck & Hess, Inc.

**Petroleum Contactors** 

P.O. Box 46 W. Newton, IN 46158 jabeals@williamsbeckandhess.com

Office: (317) 856-5659

Customer: Stop On the Way Shell Station


Attention:

Location: 4933 Lima Rd. Ft. Wayne, IN



Date: 06/25/2024

#### Deflection Readings of 8,000 gal. UST

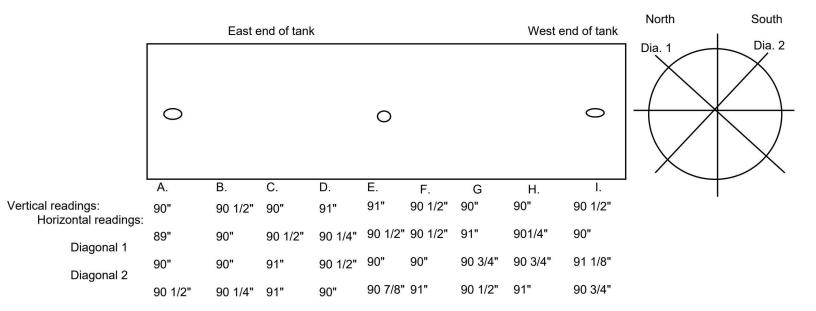

Deflection Readings are every 3' throughout tank:

This tank passes deflection readings and does not deflect more than 5%

OATH: I certify that the above information is correct and that the subject tank work was completed accordingly.

Signature of Authorized Field Installer: William Harrison

Company: WILLIAMS, BECK AND HESS, INC. Date: 06/24/2024

#### NK COMPATIBILITY COATING/INTERNAL INSPECTION/REPAIR COMPIANCE REPORT

FACILITY ID

(and/or name and address where tanks are located)

CONTRACTOR:

WILLIAMS, BECK AND HESS, INC.

Stop On The Way Shell Station

Name

P.O. BOX 46, WEST NEWTON, IN 46183

4933 Lima Rd. Ft. Wayne, IN

Address

LICENSE CONTRACTOR

William Harrison

License # is UC2018IN12869

Contact

Expiration Date: 7/17/2024

Phone

Premium 8,000 gal.

		***	
Compliance Item	Tank #1		
Tank approved for compatiblity coating (Y/N)	YES		
Full surface sanded and prepped	YES		
Mil Profile (Y/N)	YES		
Reinforcing Plates Installed (#)	N/A		
Entire Inside Surface Coated Evenly (Y/N)	YES		
Number of Coating Thickness Readings	35		
Max. Coating Thickness Readings (Top/Side/Bottom)	22/30/41		
Number of Hardness Readings	35		
Max. Hardness Reading	84		
Min. Hardness Reading	82		
Full Holiday Test Passed (Y/N)	N/A		
Pictures of tanks internal	YES		
Number of Holes	NONE		
Age of Tank	UNKNOWN		
Seam Leak	NONE		

Brand & Model of Thickness Tester Brand & Model of Hardness Tester Brand & Model of Lining Material Brand and Model of Holiday Tester Brand & Model of Ultrasonic Thickness Gauge

Elcometer 345 Barber Colman GYZJ935 Enviroline 376F-30 N/A N/A

OATH:

I certify that the above information is correct and that the subject tank lining work was completed according to specifications of the lining material manufactureer and NLPA 631.

Signature of Authorized Field Installer: William Harrison

Company: WILLIAMS, BECK AND HESS, INC.

Date: 6/24/2024

## Williams, Beck & Hess, Inc. Petroleum Contactors

P.O. Box 46 W. Newton, IN 46158

jbeals1977@gmail.com Office: (317) 856-5659











