



**UNDERGROUND STORAGE
TANK INSPECTION REPORT**

INDIANA DEPARTMENT OF
ENVIRONMENTAL MANAGEMENT

UST FAC ID: **22613**

Inspector's Name:	Todd Settles
Date:	June 20, 2024
Time In:	09:00
Time Out:	10:30
Inspection Type:	Initial

FACILITY NAME / LOCATION

FACILITY NAME Crystal Food Corporation		FACILITY ADDRESS (number and street) 6851 Broadway		
ADDRESS (line 2)	CITY Merrillville	STATE IN	ZIP CODE 46410	COUNTY Lake

UST OWNER

UST Owner Name (If in Individual Capacity) Crystal Foods Corporation				BUSINESS ID (From the Secretary of State) 1994061505	
PREFIX Mr.	FIRST NAME Zahid	MI	LAST NAME Iqbal	SUFFIX	
TELEPHONE NUMBER (219) 588-4606		EMAIL ADDRESS crystalfd@yahoo.com			

UST OPERATOR


UST Operator Name (If in Individual Capacity) Crystal Foods Corporation				BUSINESS ID (From the Secretary of State) 1994061505	
PREFIX Mr.	FIRST NAME Zahid	MI	LAST NAME Iqbal	SUFFIX	
TELEPHONE NUMBER (219) 588-4606		EMAIL ADDRESS crystalfd@yahoo.com			


PROPERTY OWNER


UST Property Owner Name (If in Individual Capacity) Prince Petroleum Inc				BUSINESS ID (From the Secretary of State) 201805111257701	
PREFIX Mr.	FIRST NAME Daljit	MI	LAST NAME Singh	SUFFIX	
TELEPHONE NUMBER		EMAIL ADDRESS			

COMPLIANCE ELEMENTS

All USTs properly registered and up-to-date notification form on file	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK
2024 Tank Fees due 5/15/24, Notification Form needs updated property owner information						
O/O is in compliance with reporting & record keeping requirements	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK
O/O is in compliance with release reporting or investigation	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
O/O is in compliance with all UST closure requirements	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
O/O has met all financial responsibility requirements	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
40 CFR 280, Subpart A installation requirements (partially excluded) met	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input checked="" type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
40 CFR 280, Subpart B installation and upgrade requirements met	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK
Piping metal connectors and flex connectors in contact with soil in all UDCs with no CP in place						
40 CFR 280, Subpart C spill/overflow control requirements met	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
40 CFR 280, Subpart C compatibility requirements met	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/> N/A	<input type="checkbox"/>	<input type="checkbox"/> UNK
40 CFR 280, Subpart C O&M and testing requirements met	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK
Overfill testing, monthly/annual walkthroughs were not provided						
40 CFR 280, Subpart D release detection requirements met	<input type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input checked="" type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK
ATG/probes, line tightness, leak detector testing was not provided						
40 CFR 280, Subpart J operator training requirements met	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> UNK

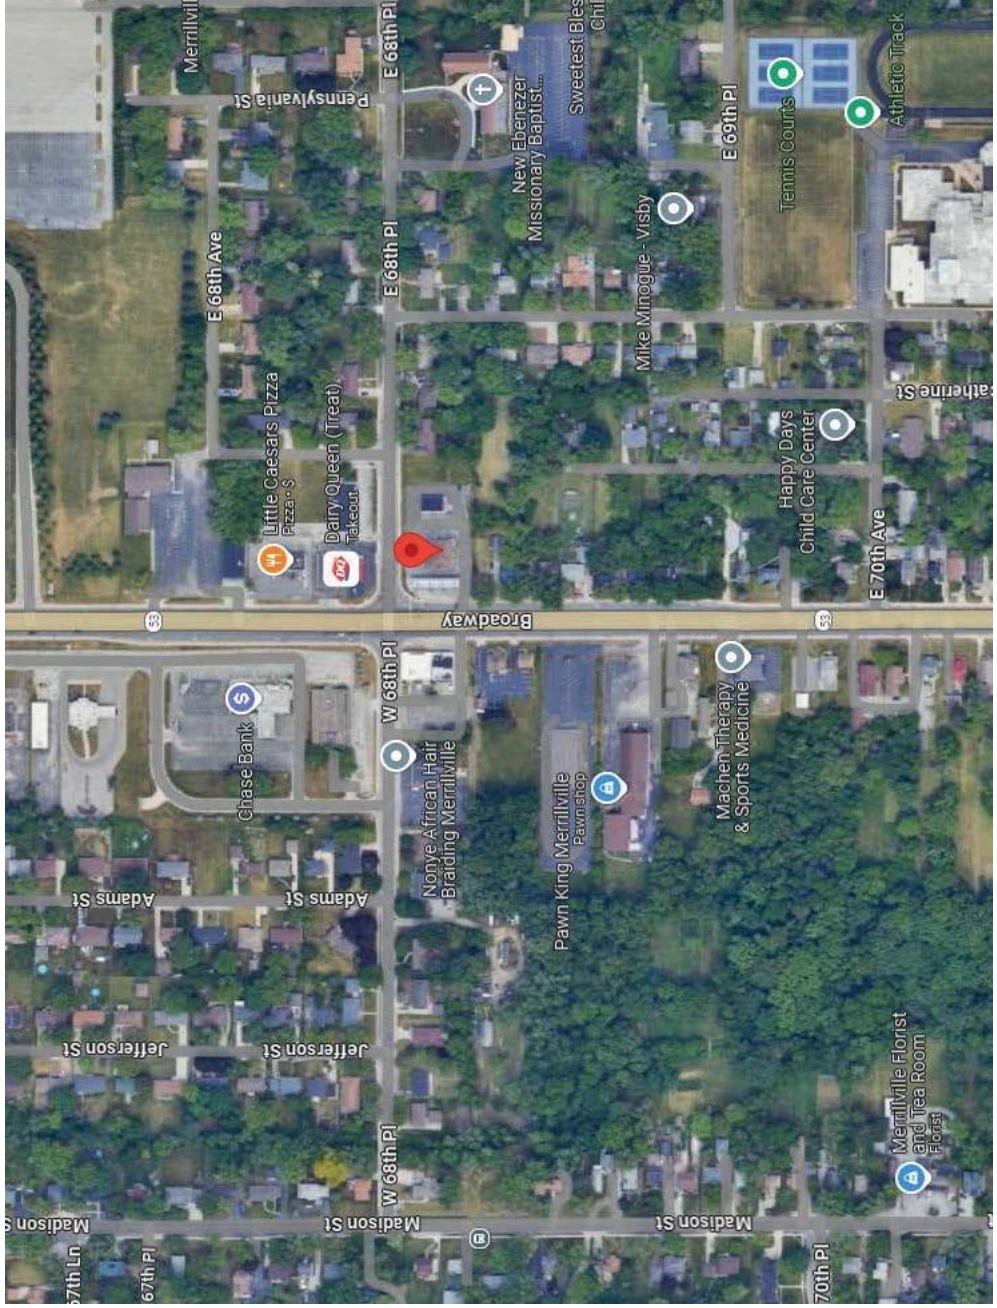

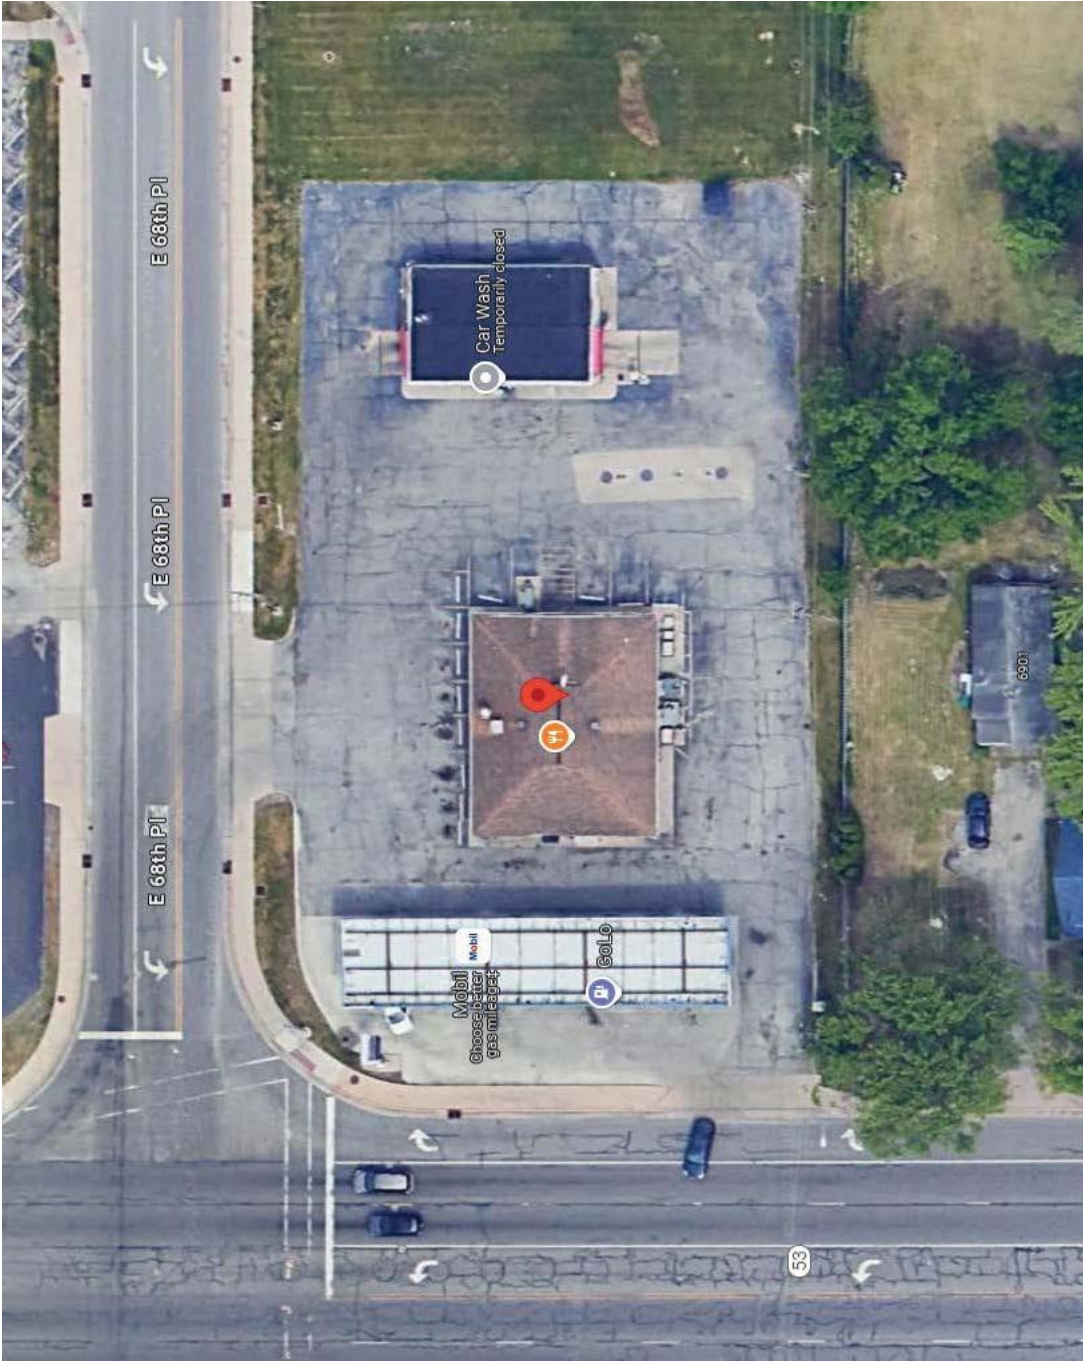

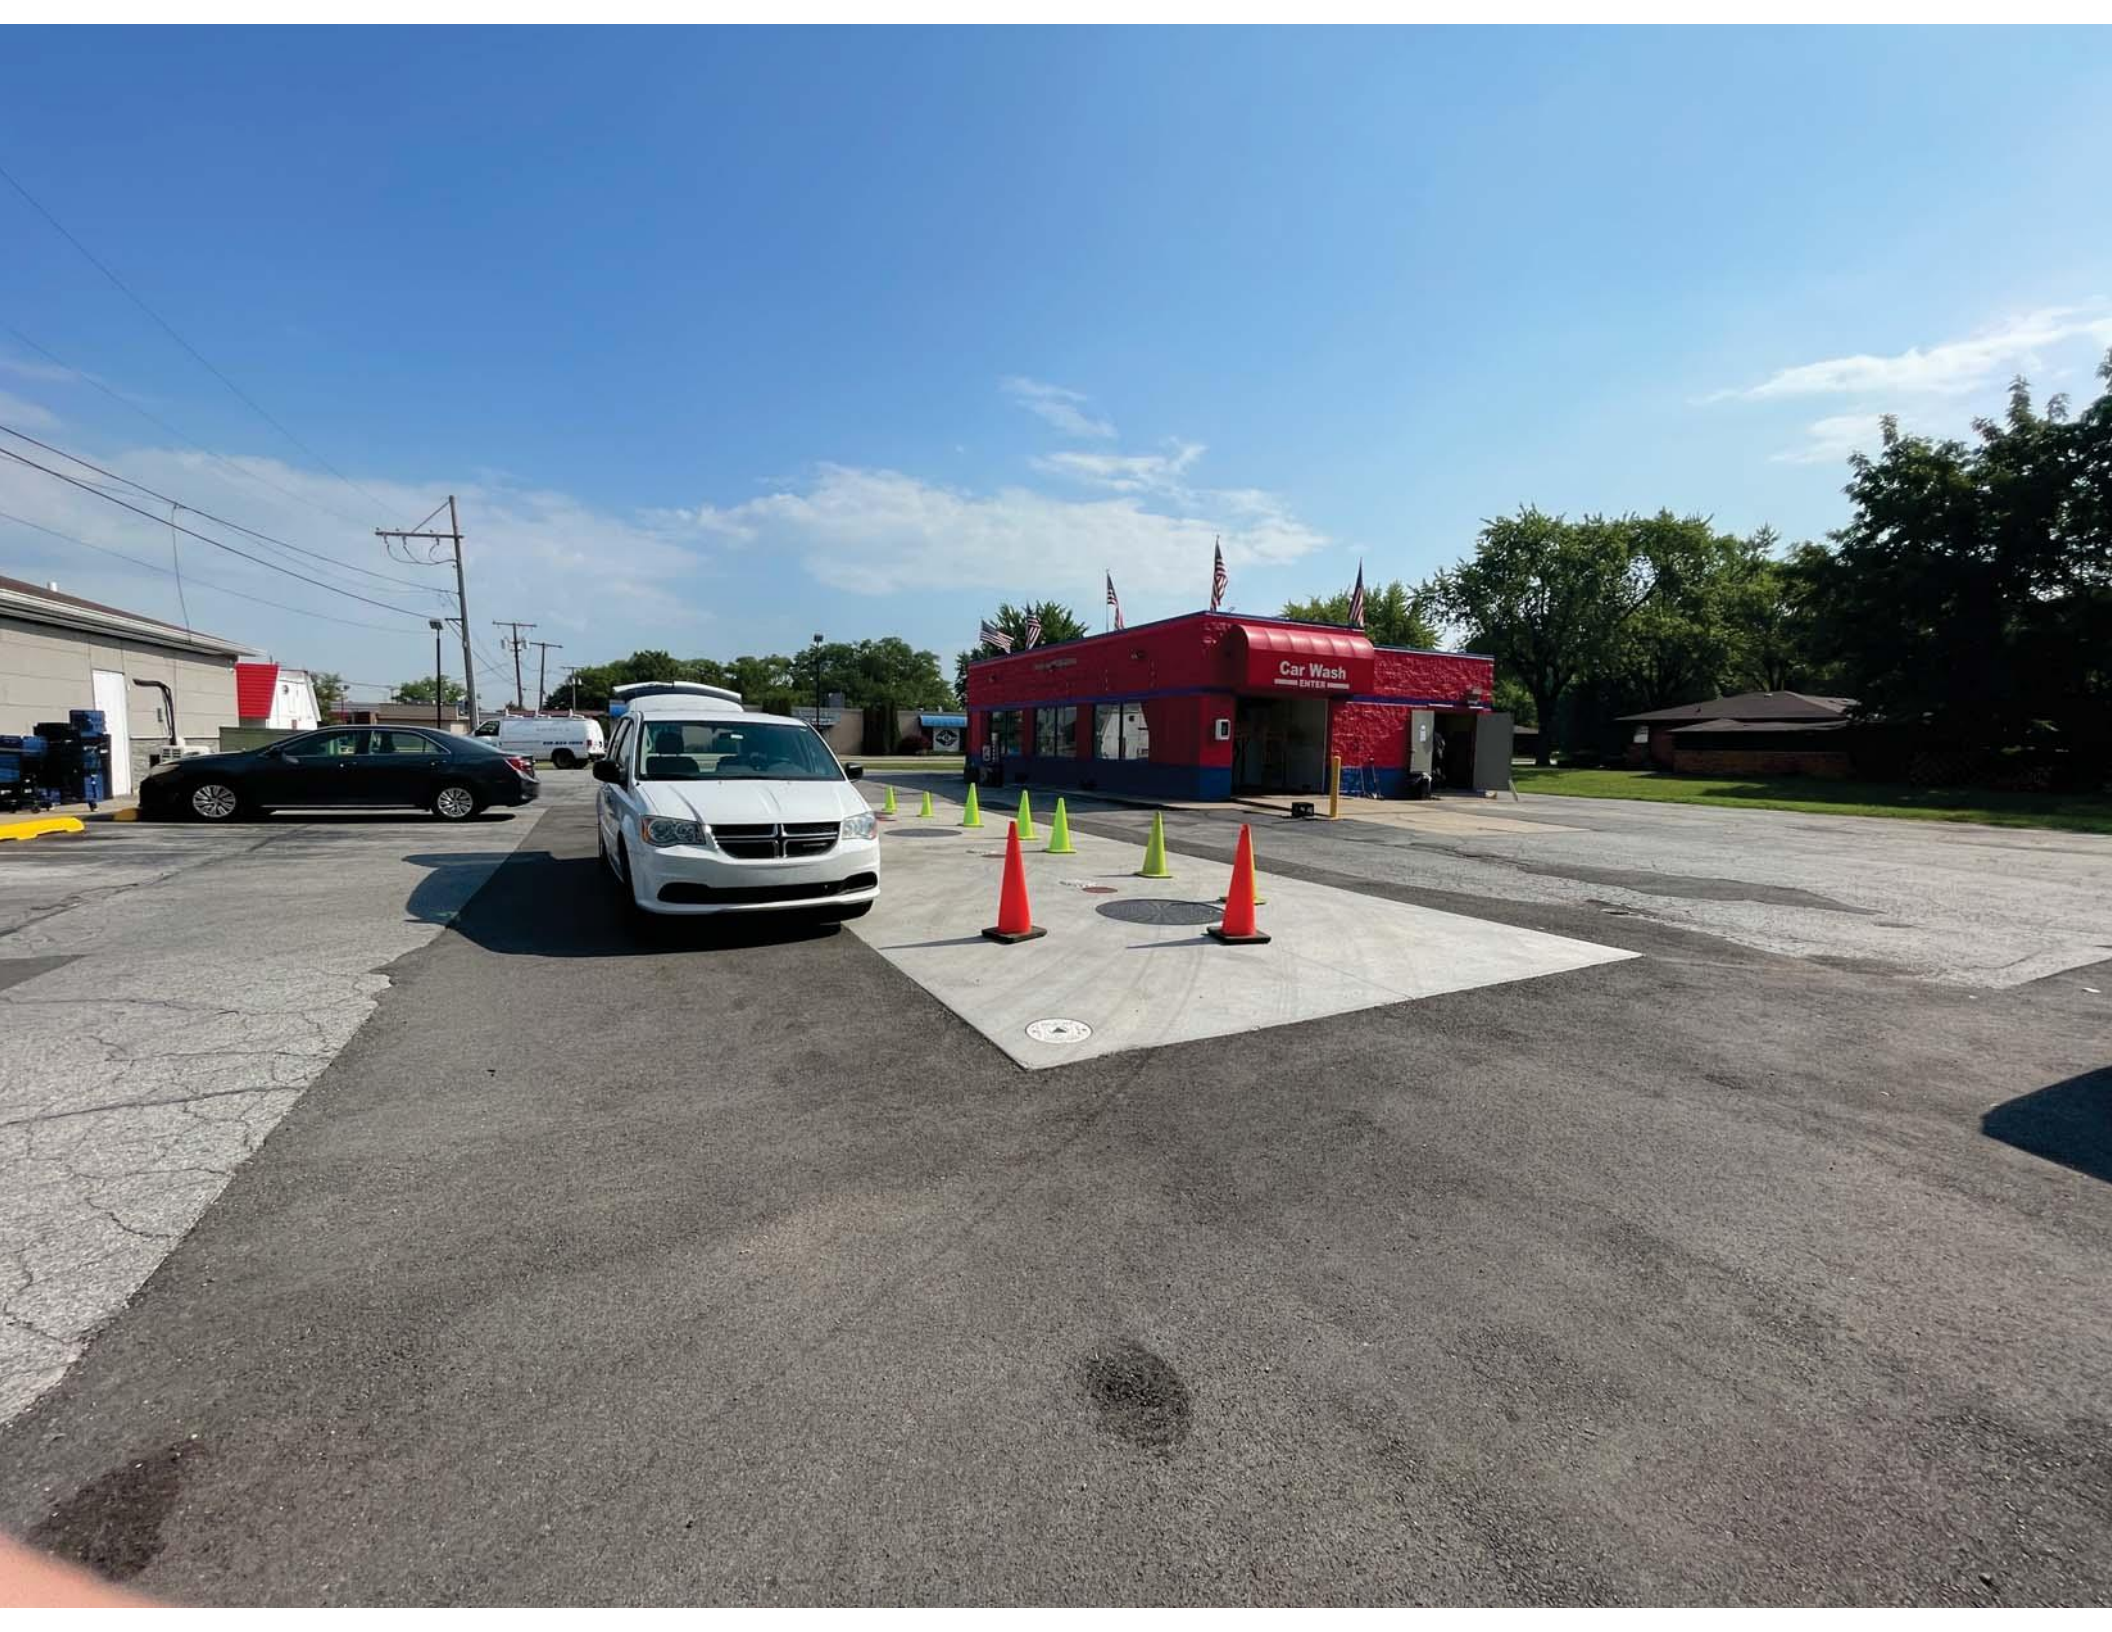











ENT CO.

om

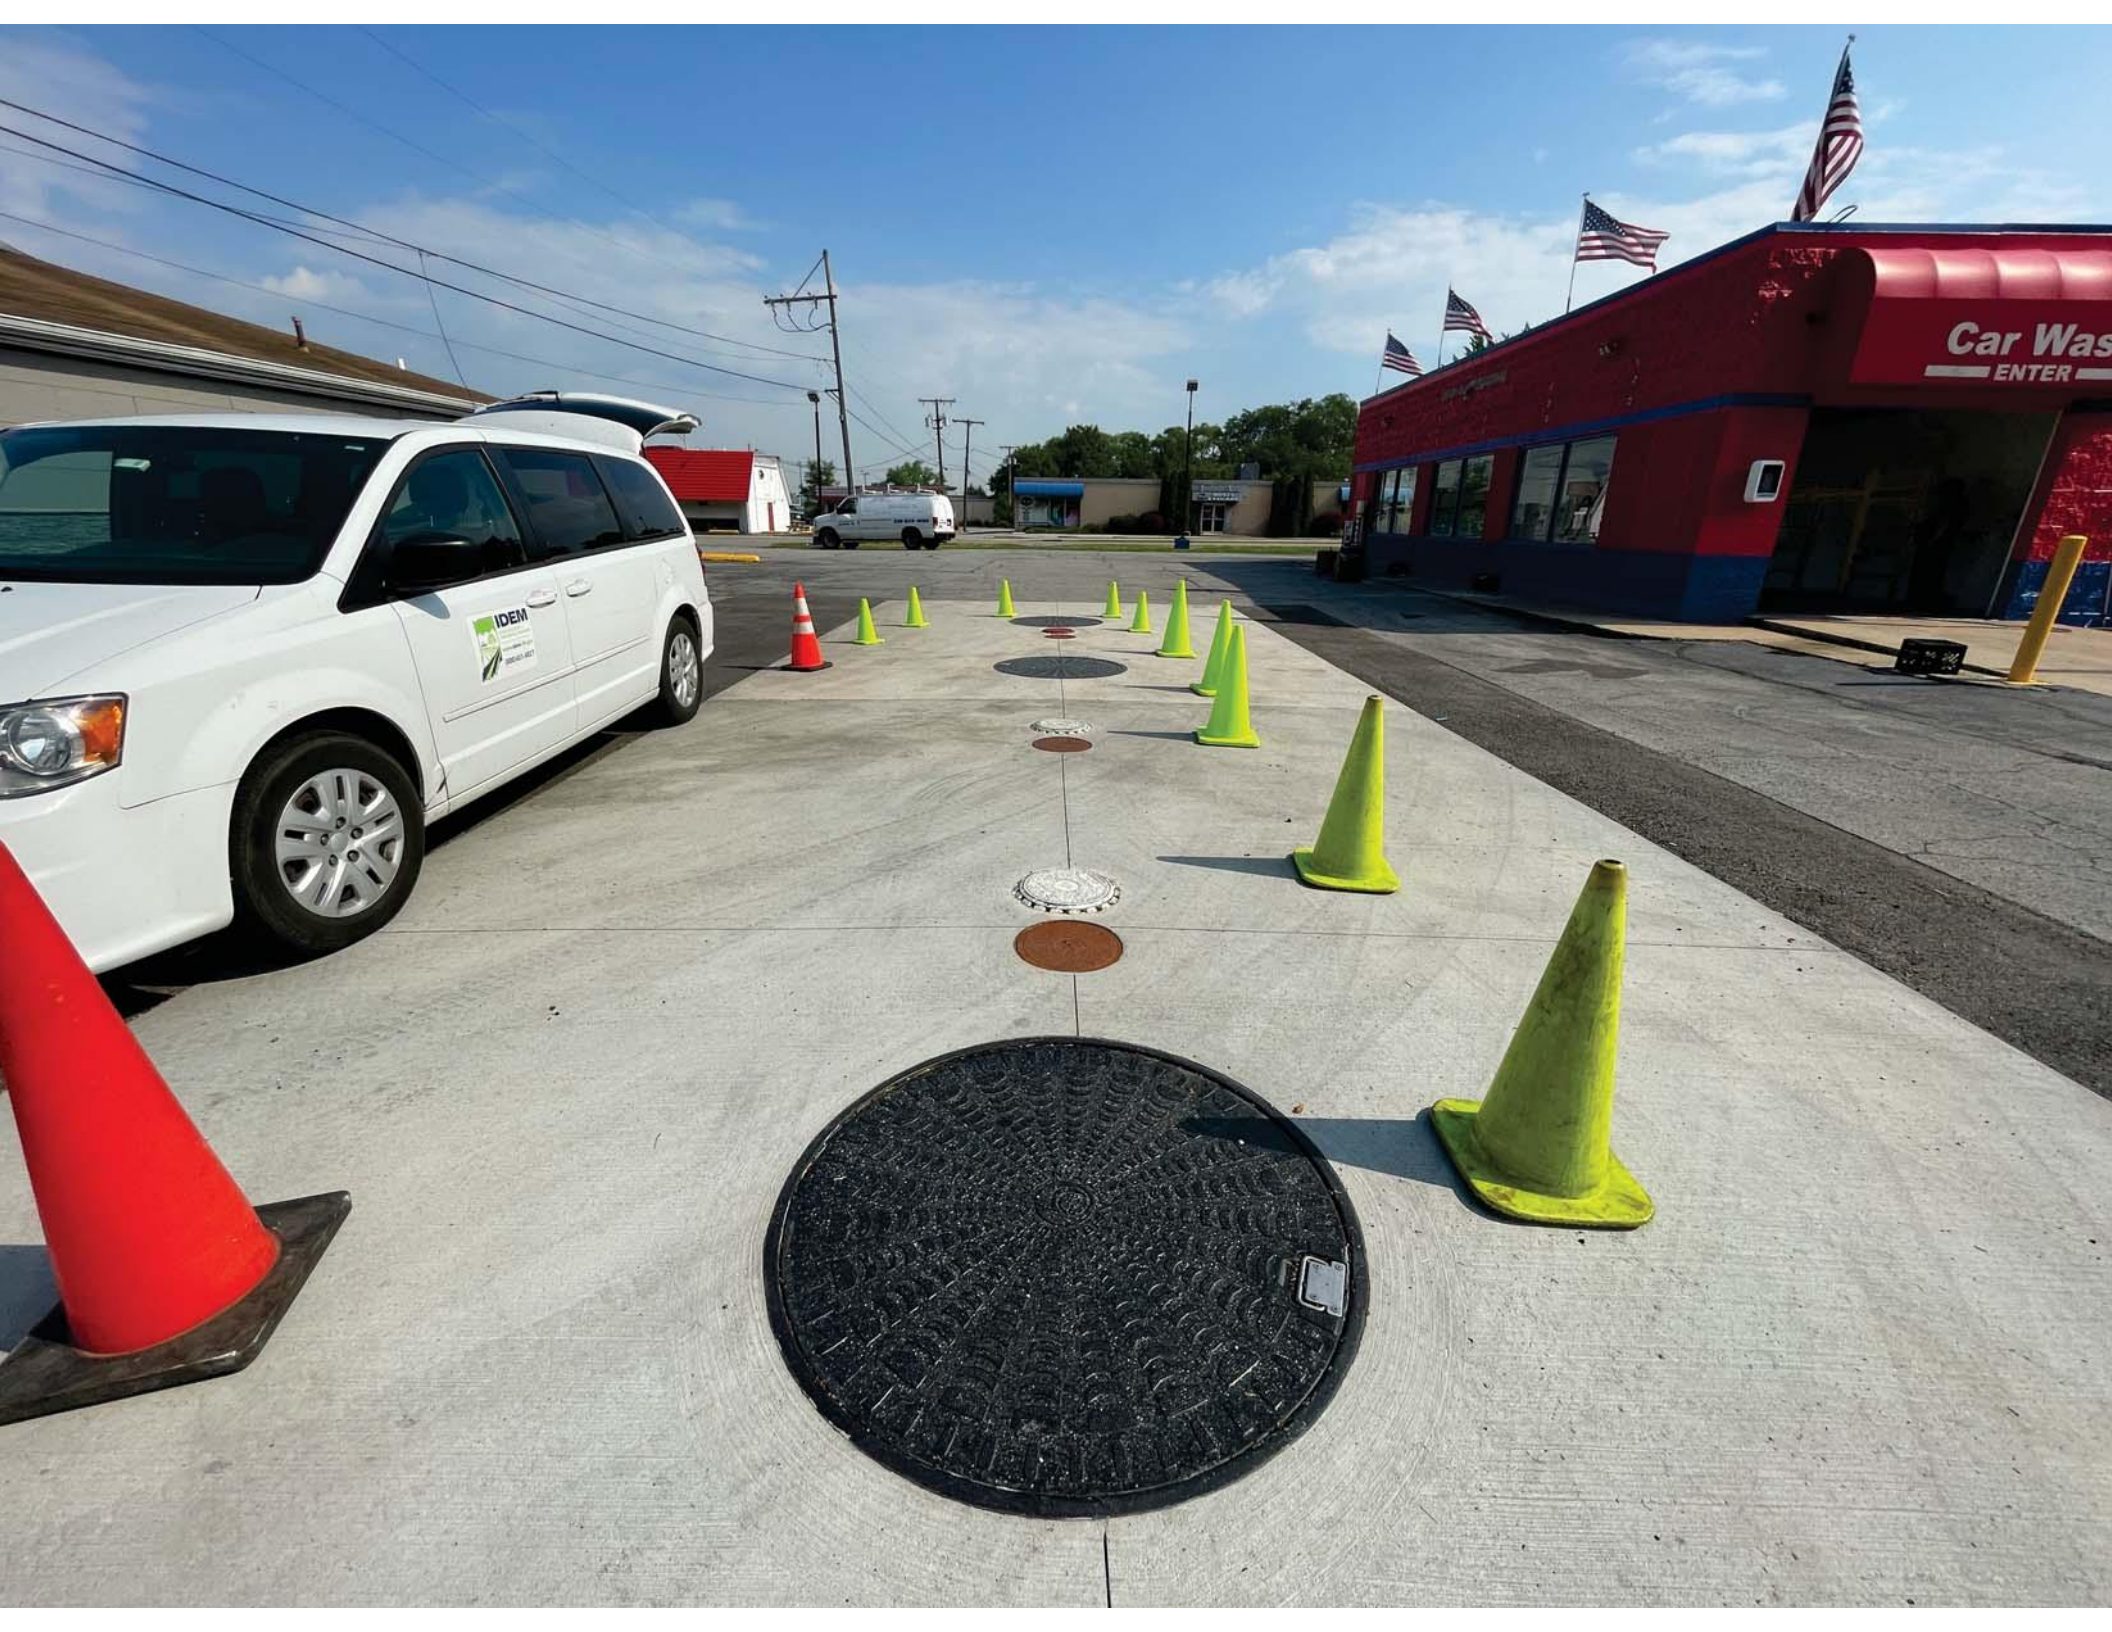

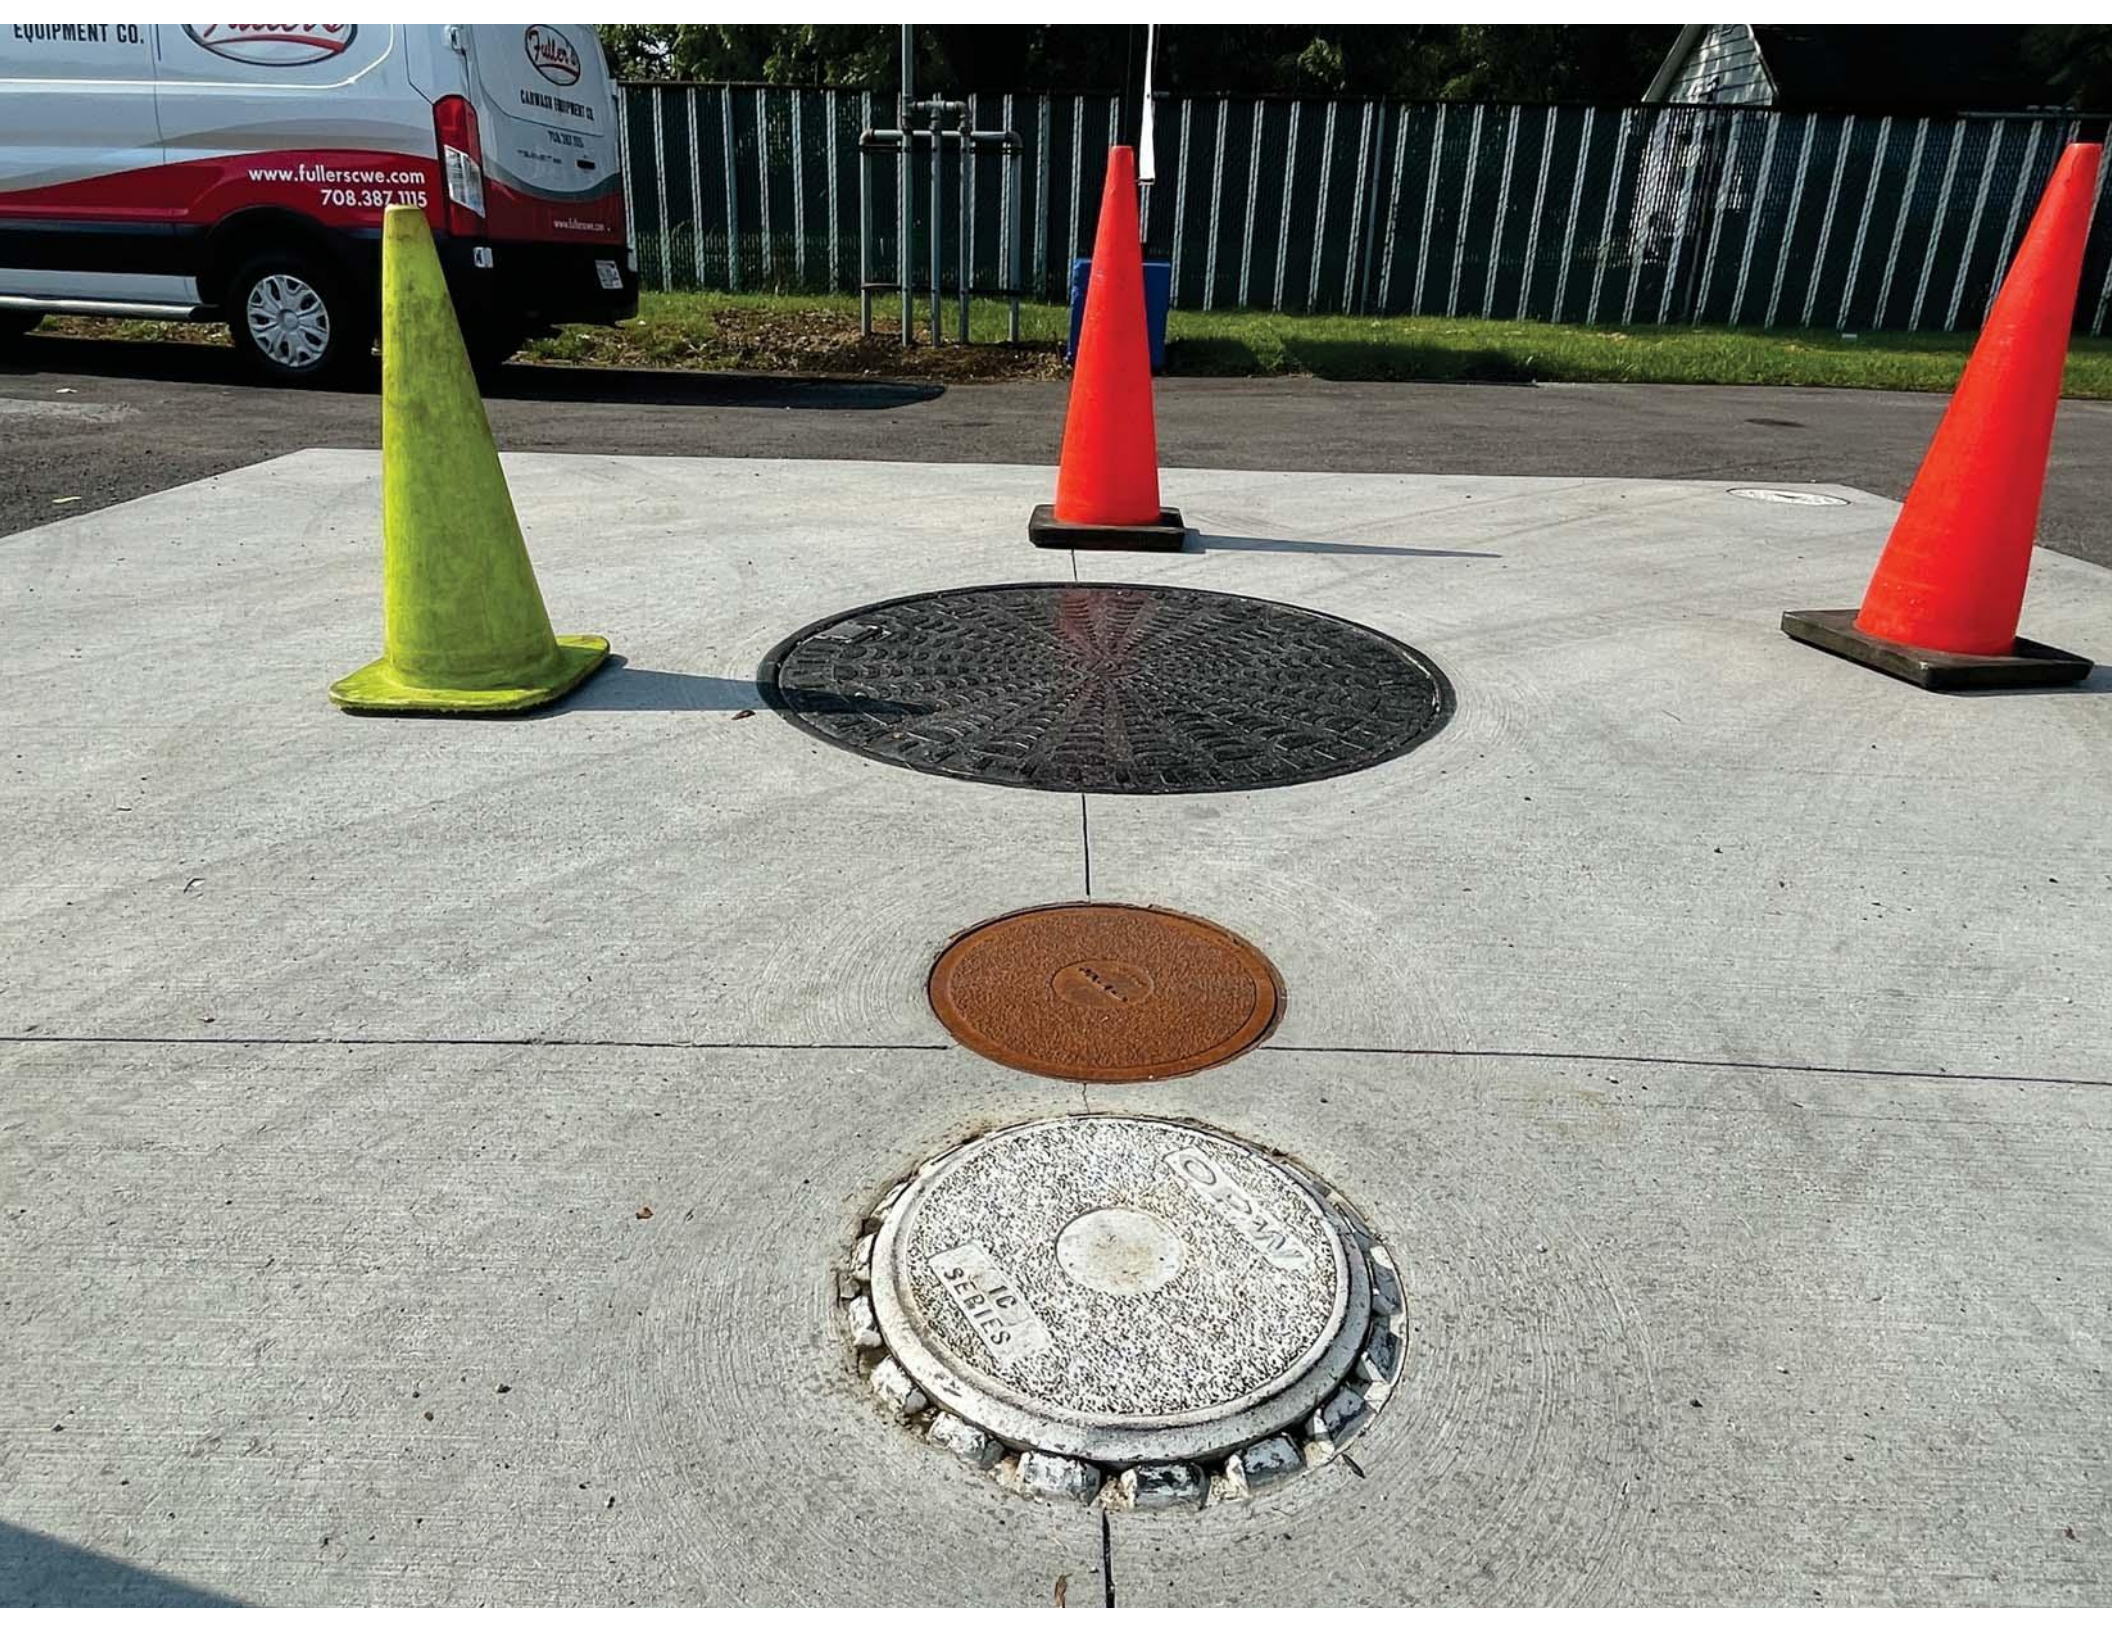

www.fullerscwe.com
708.387.1115

MANHOLE

SERIES
OP-11



OPW

1000

OPW



OPW

SERIES 10



MADE IN TAINMAN
CORP. / OFW BIV


SYSTEMS
ER
TE BASE
P/N: C080073M

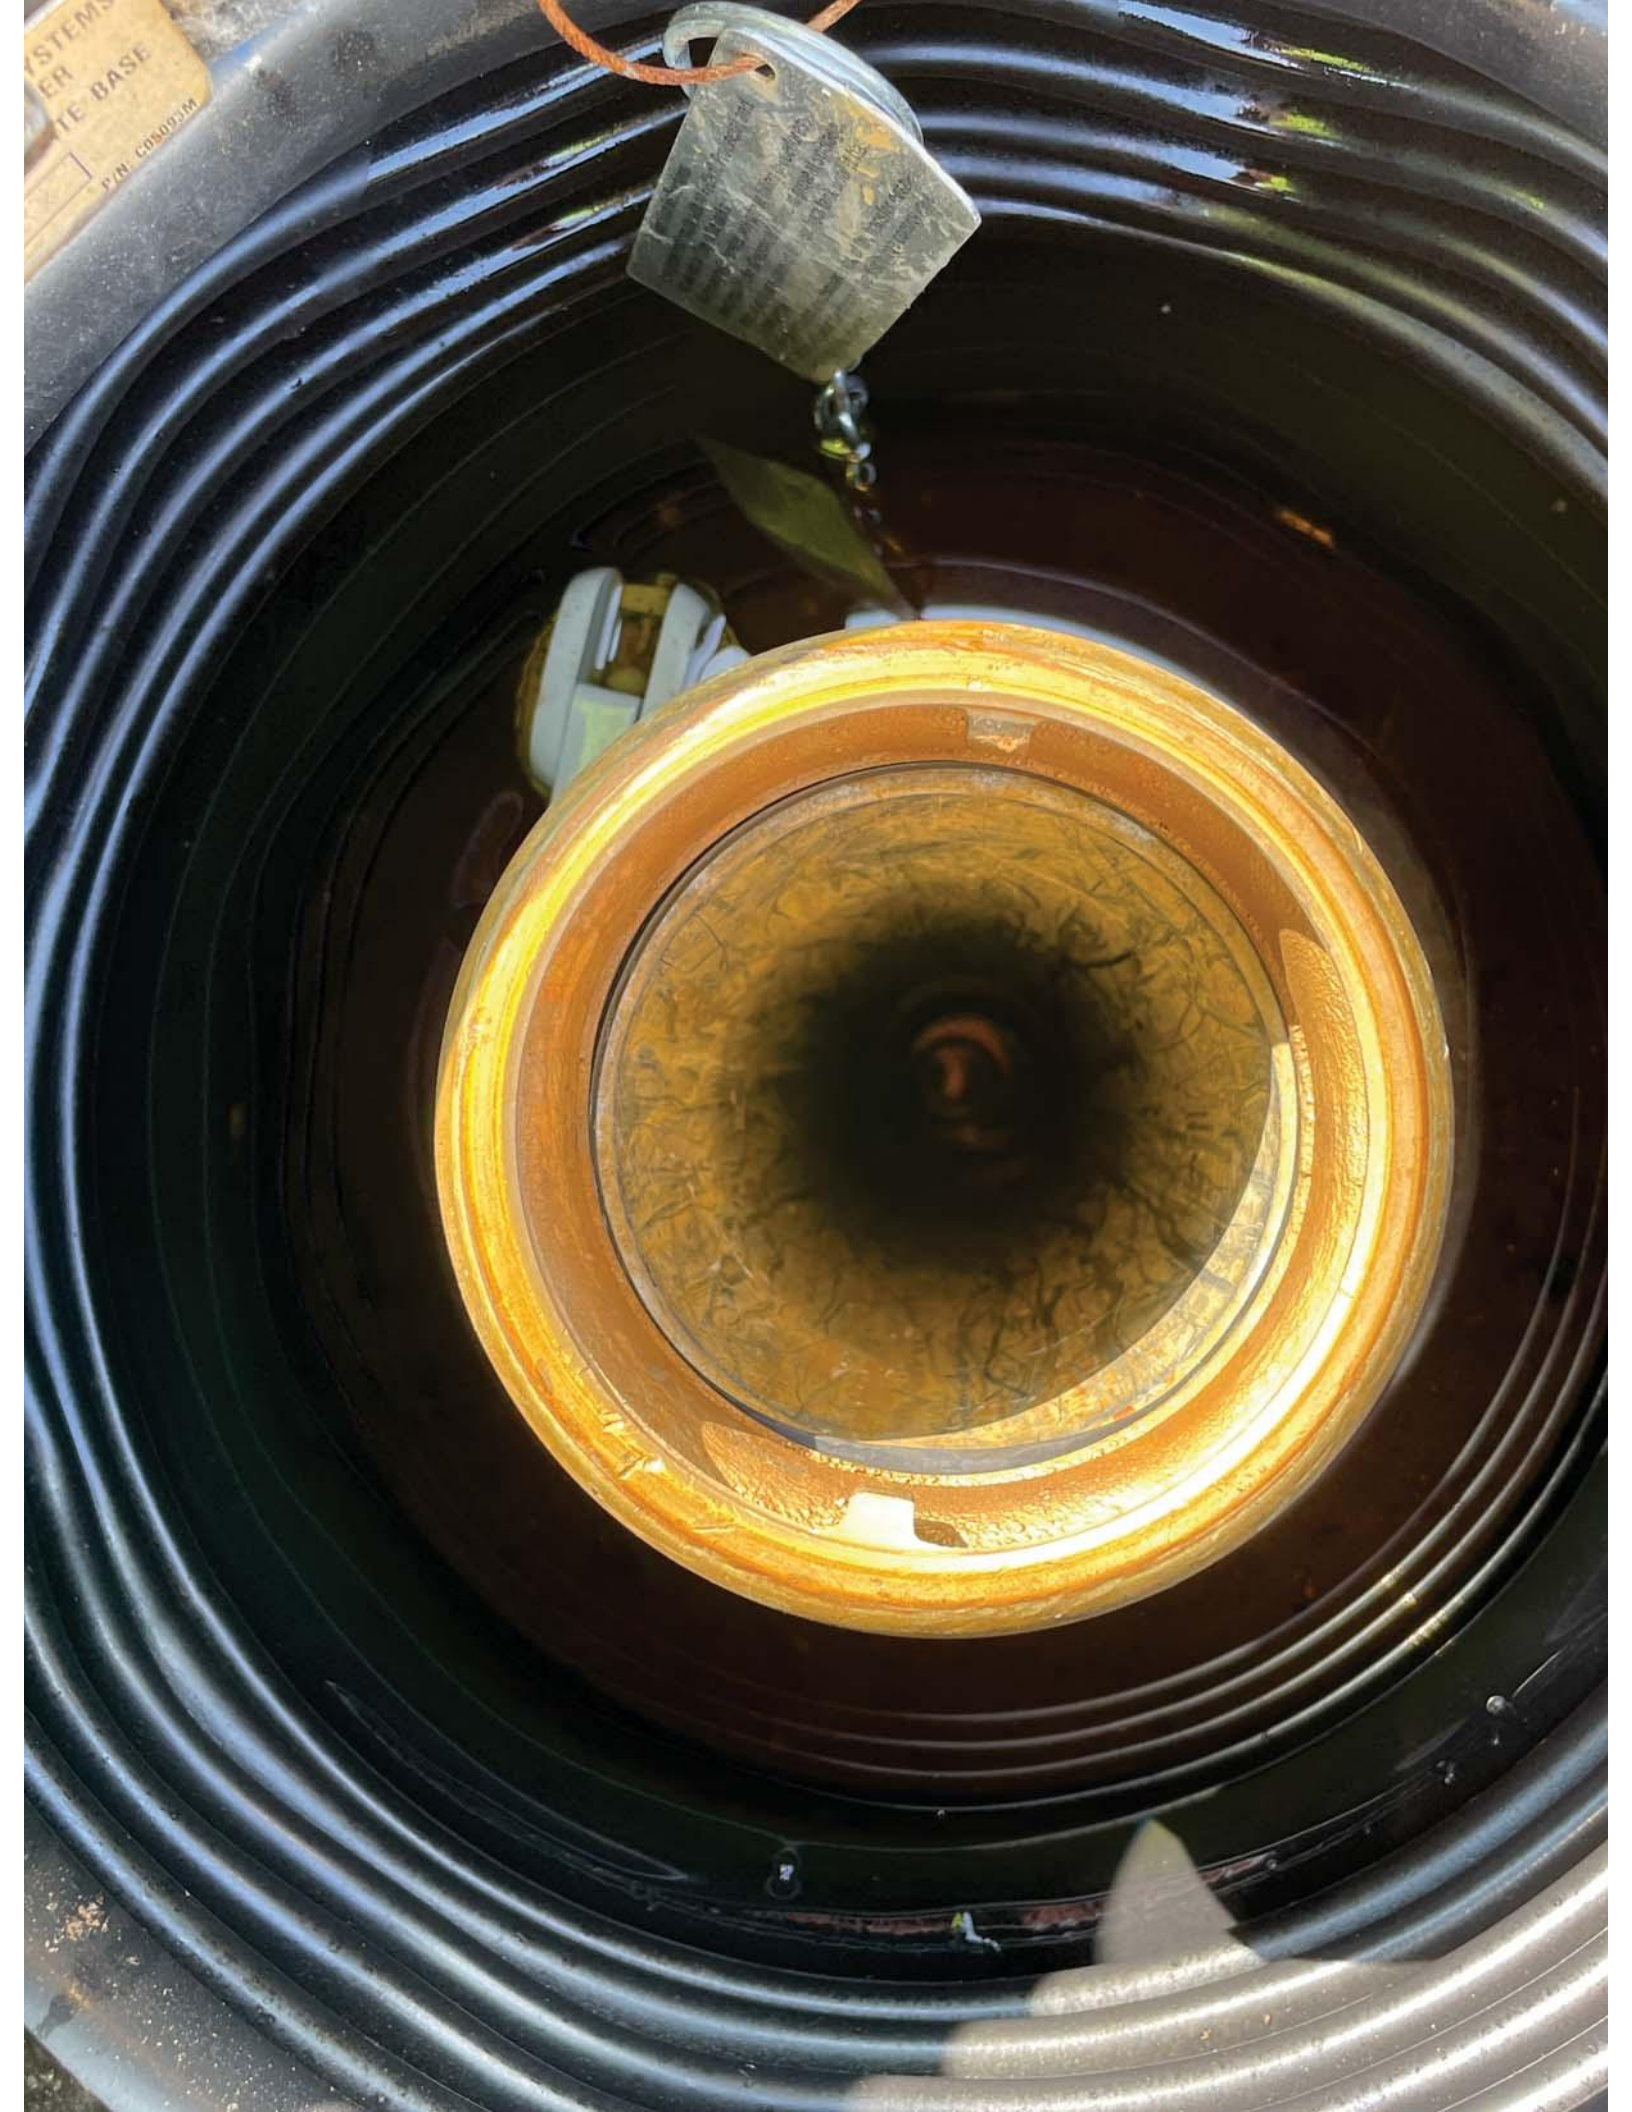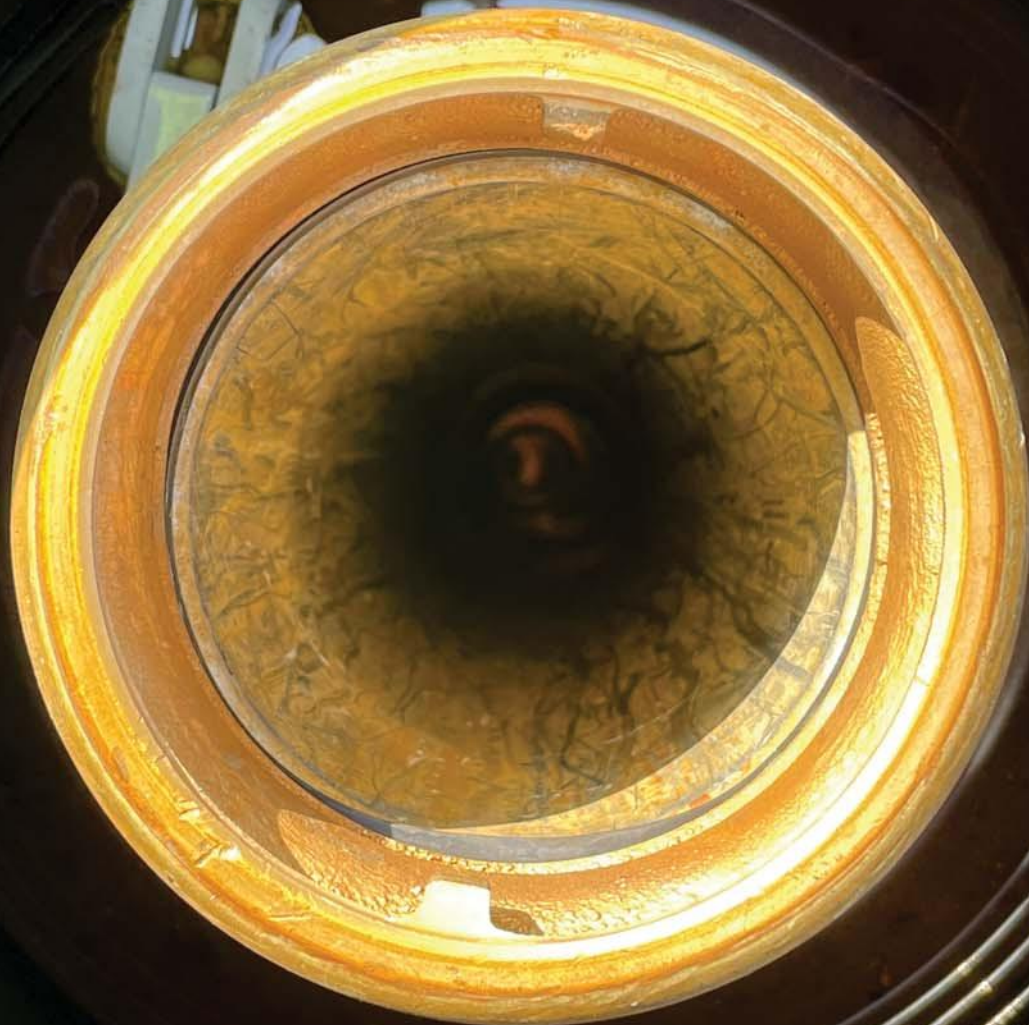








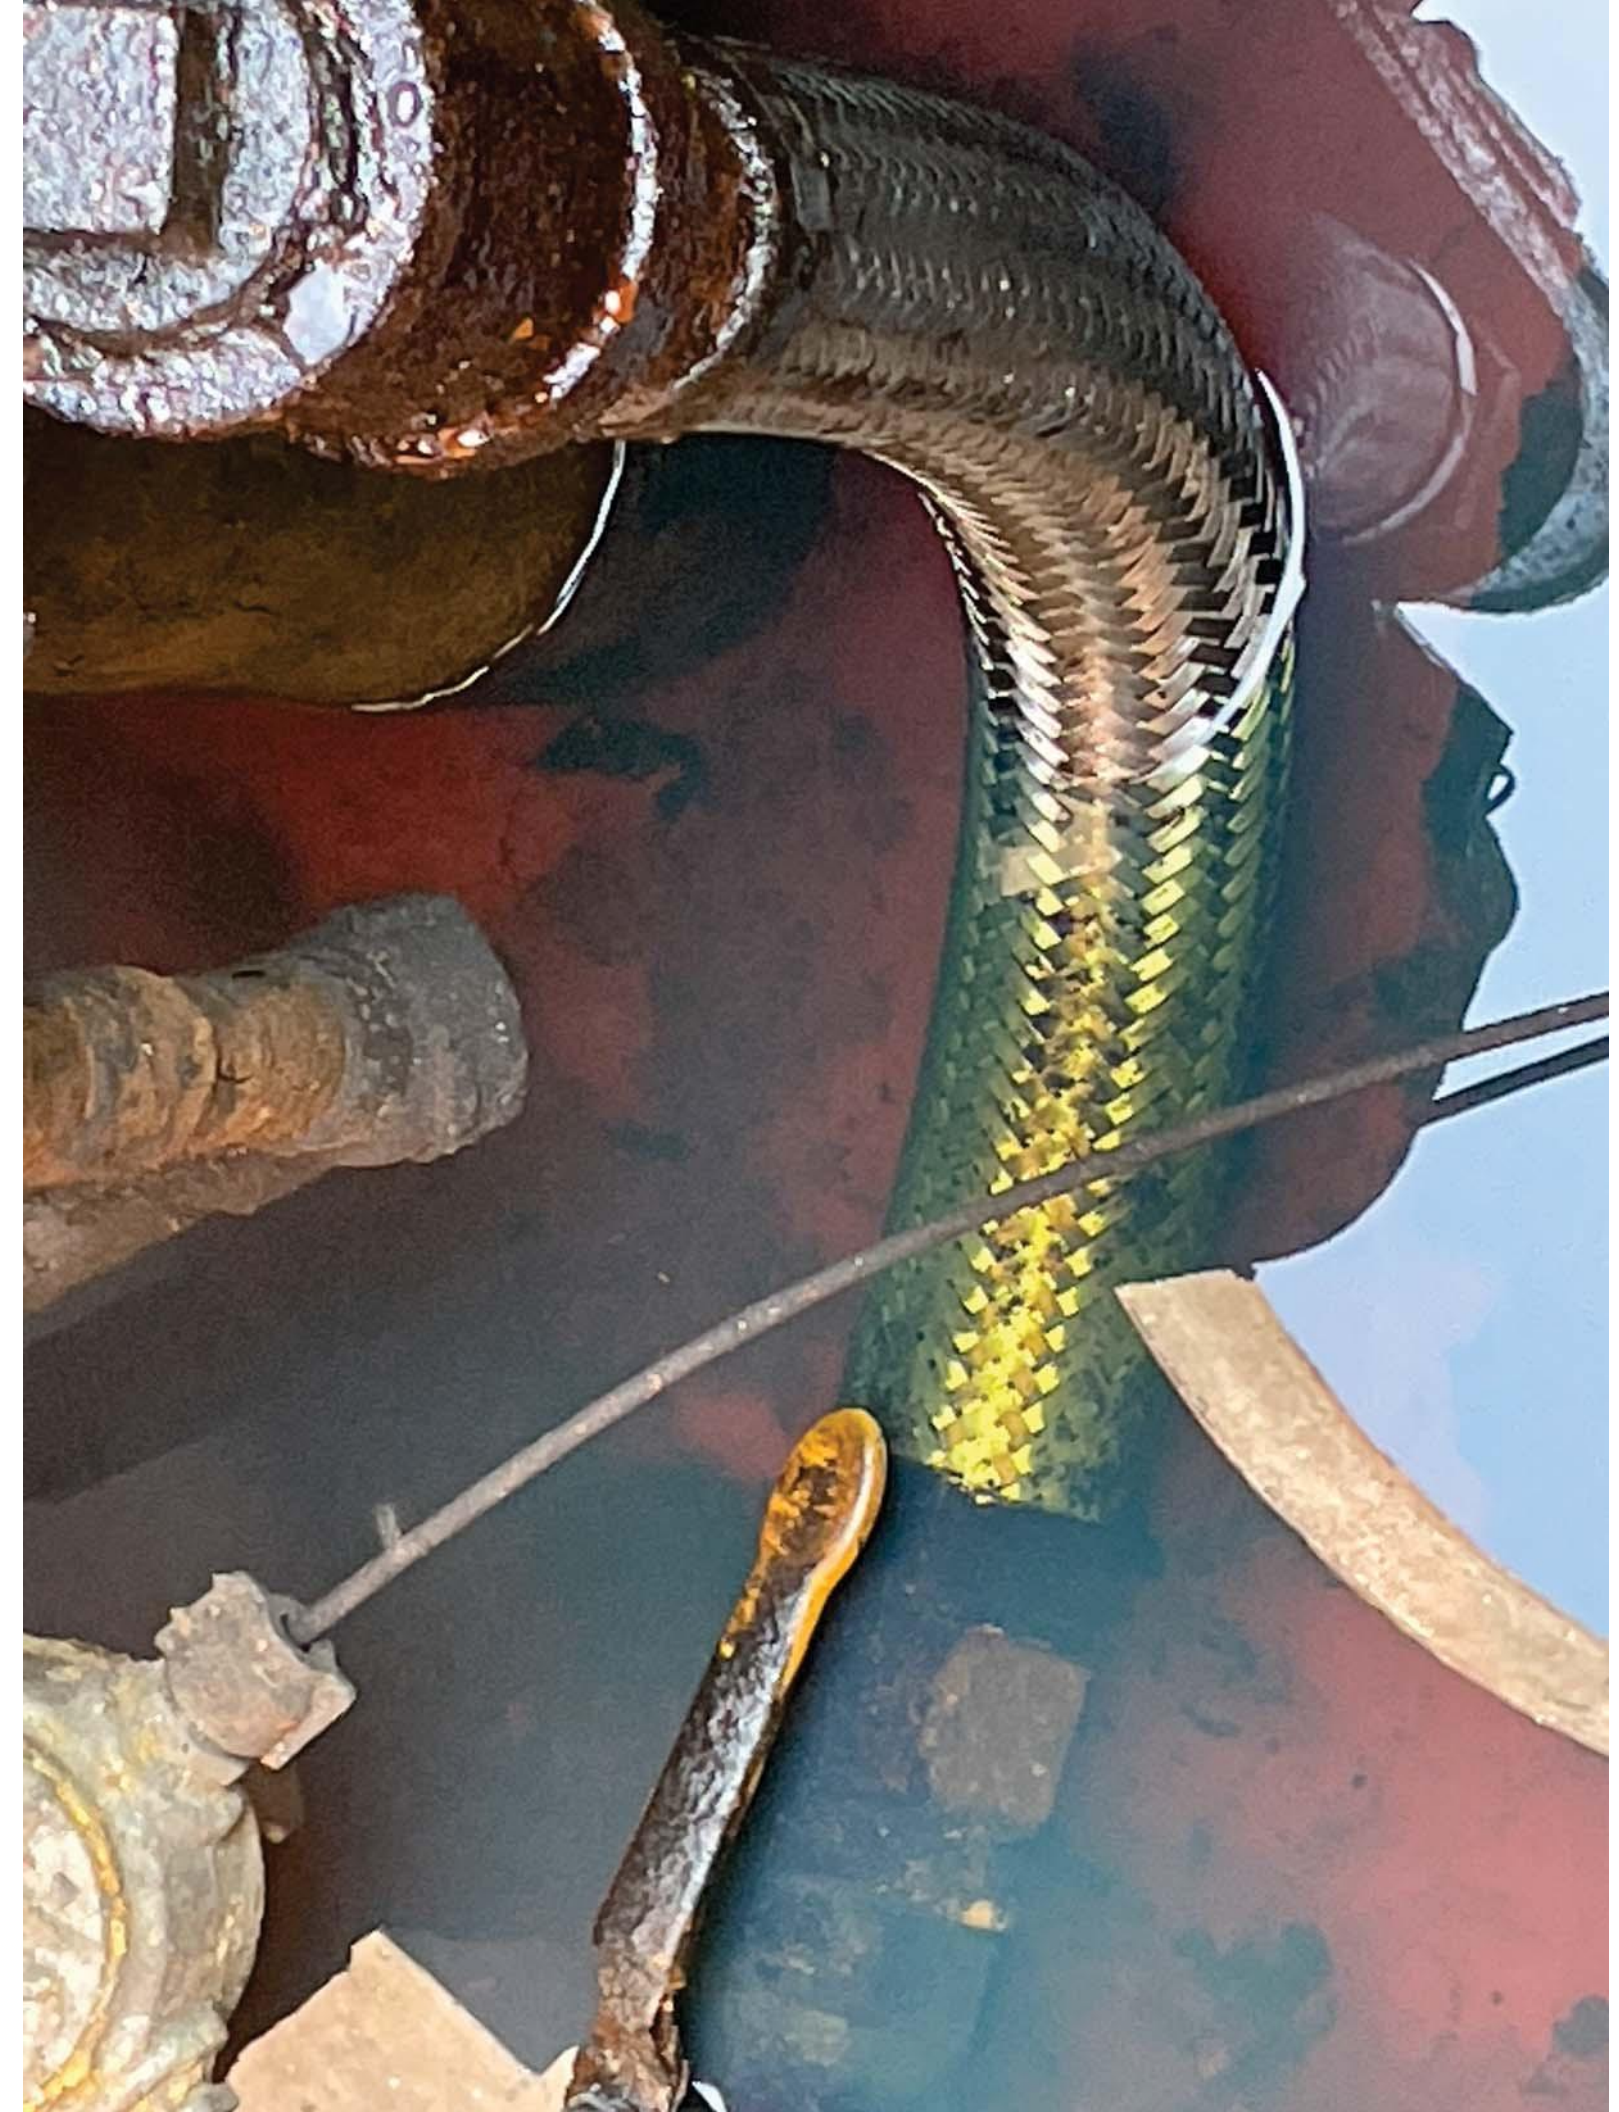

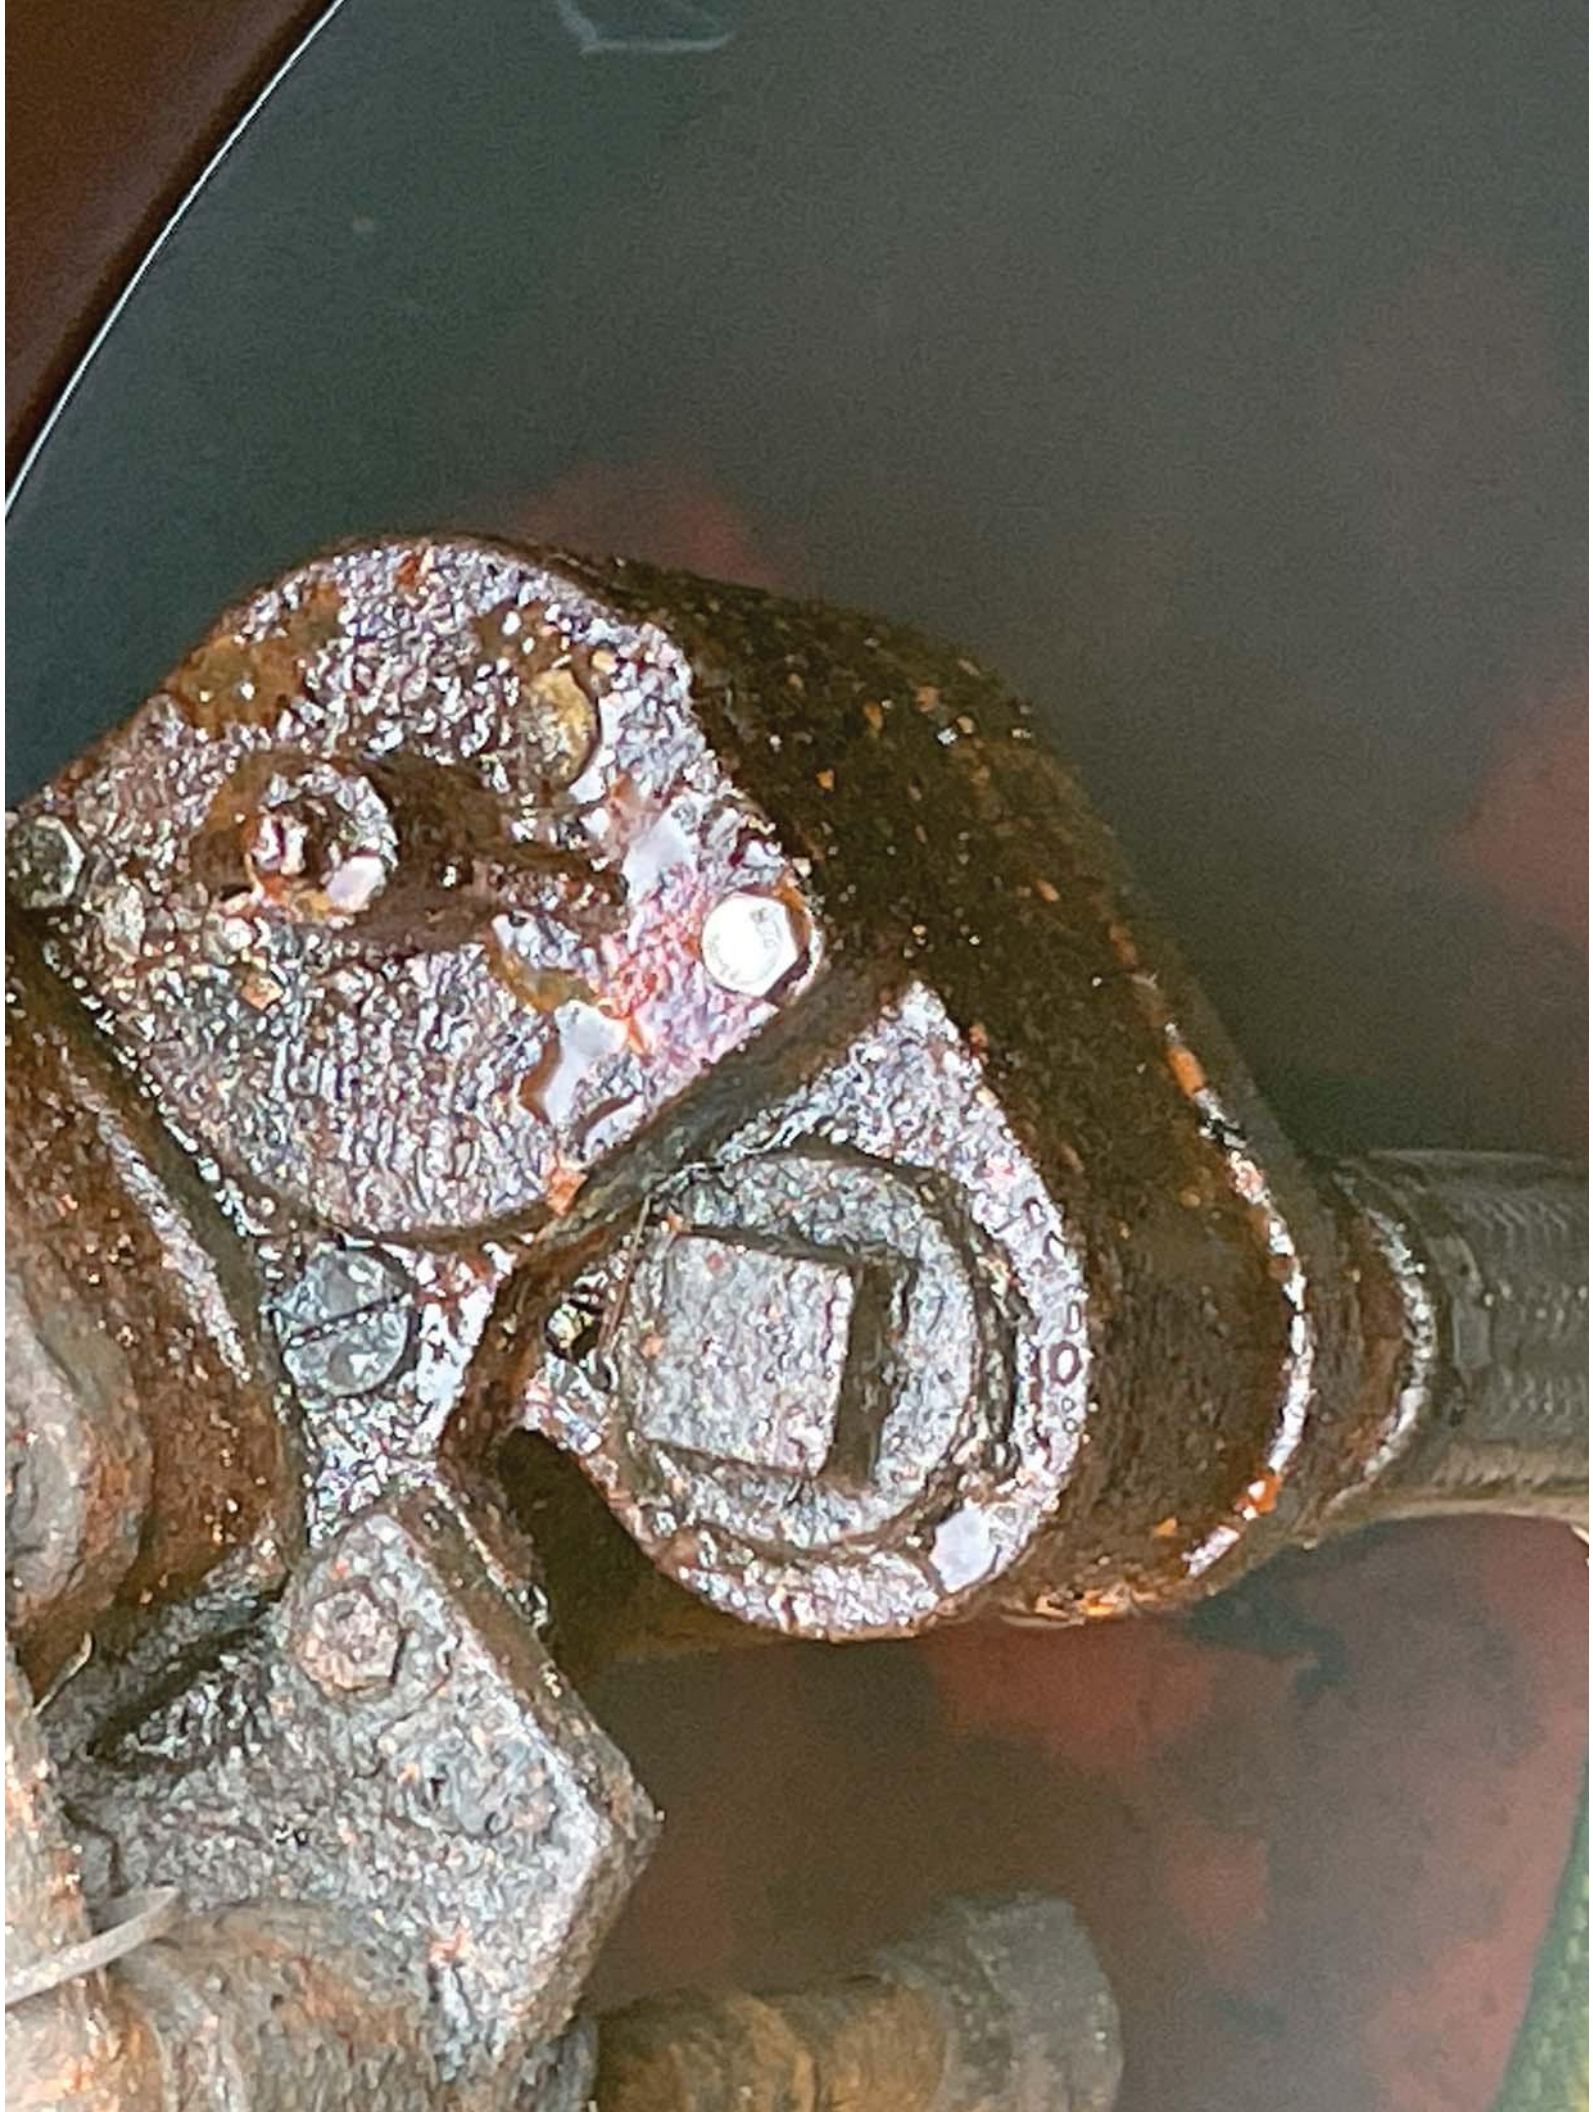









SERIES
1C

OPBM

OPBM
M&O

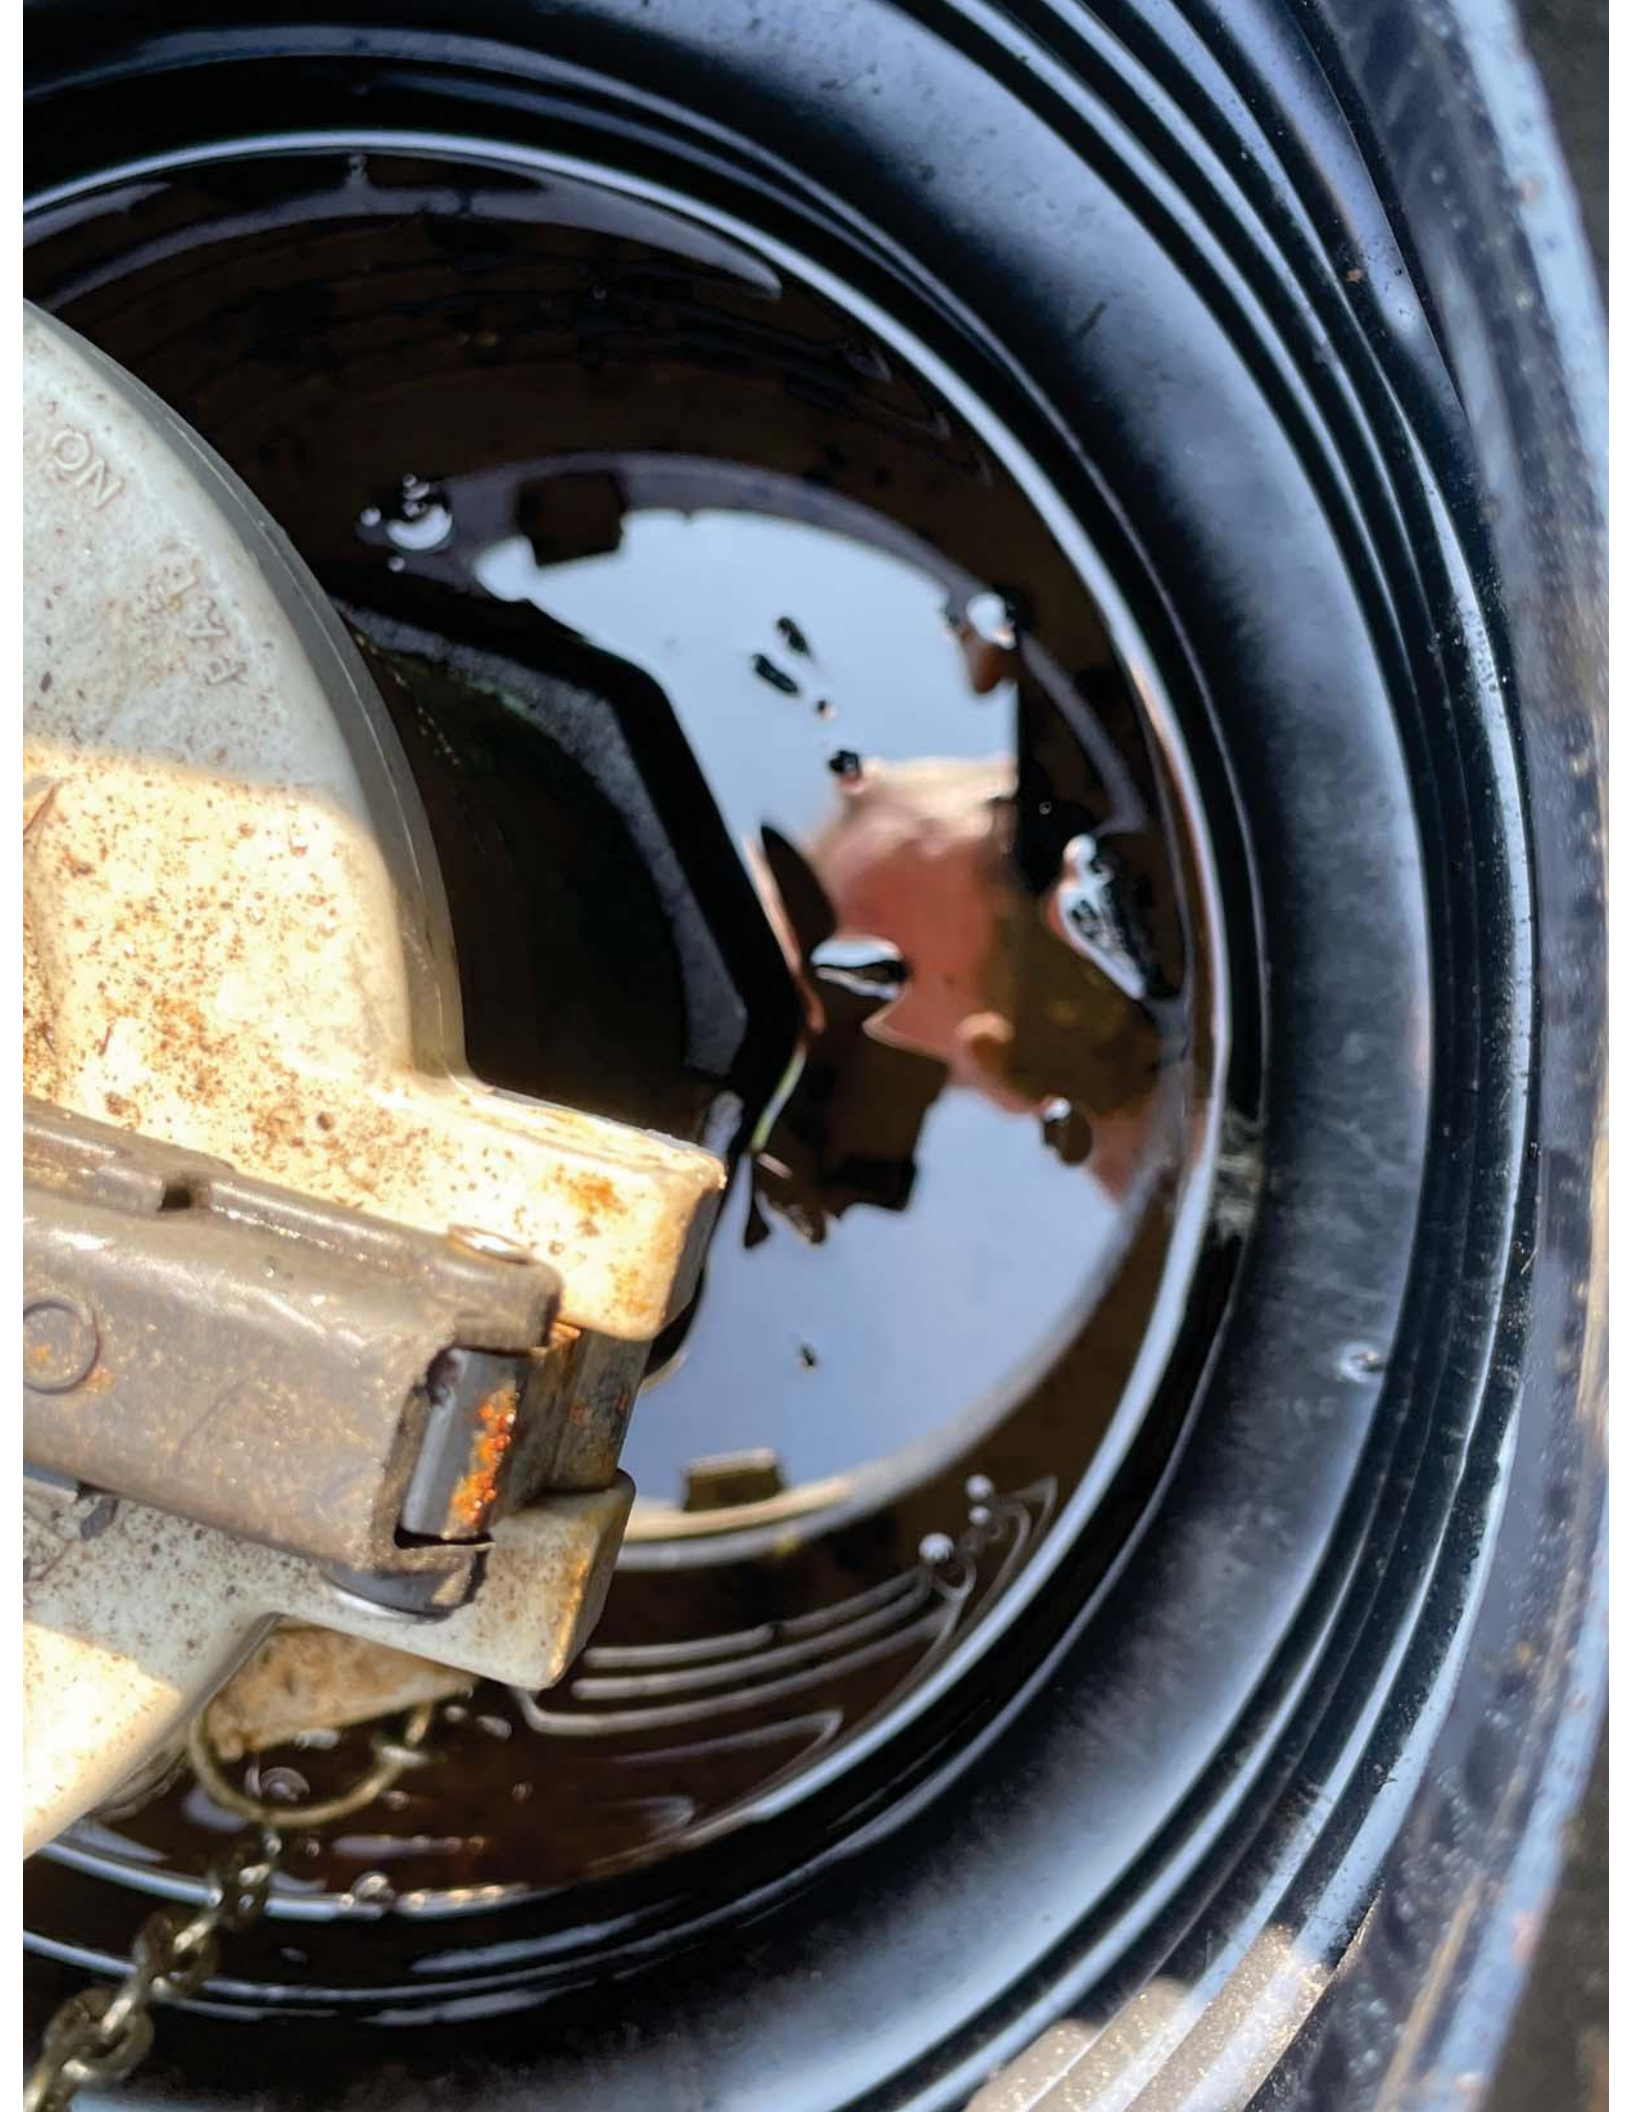

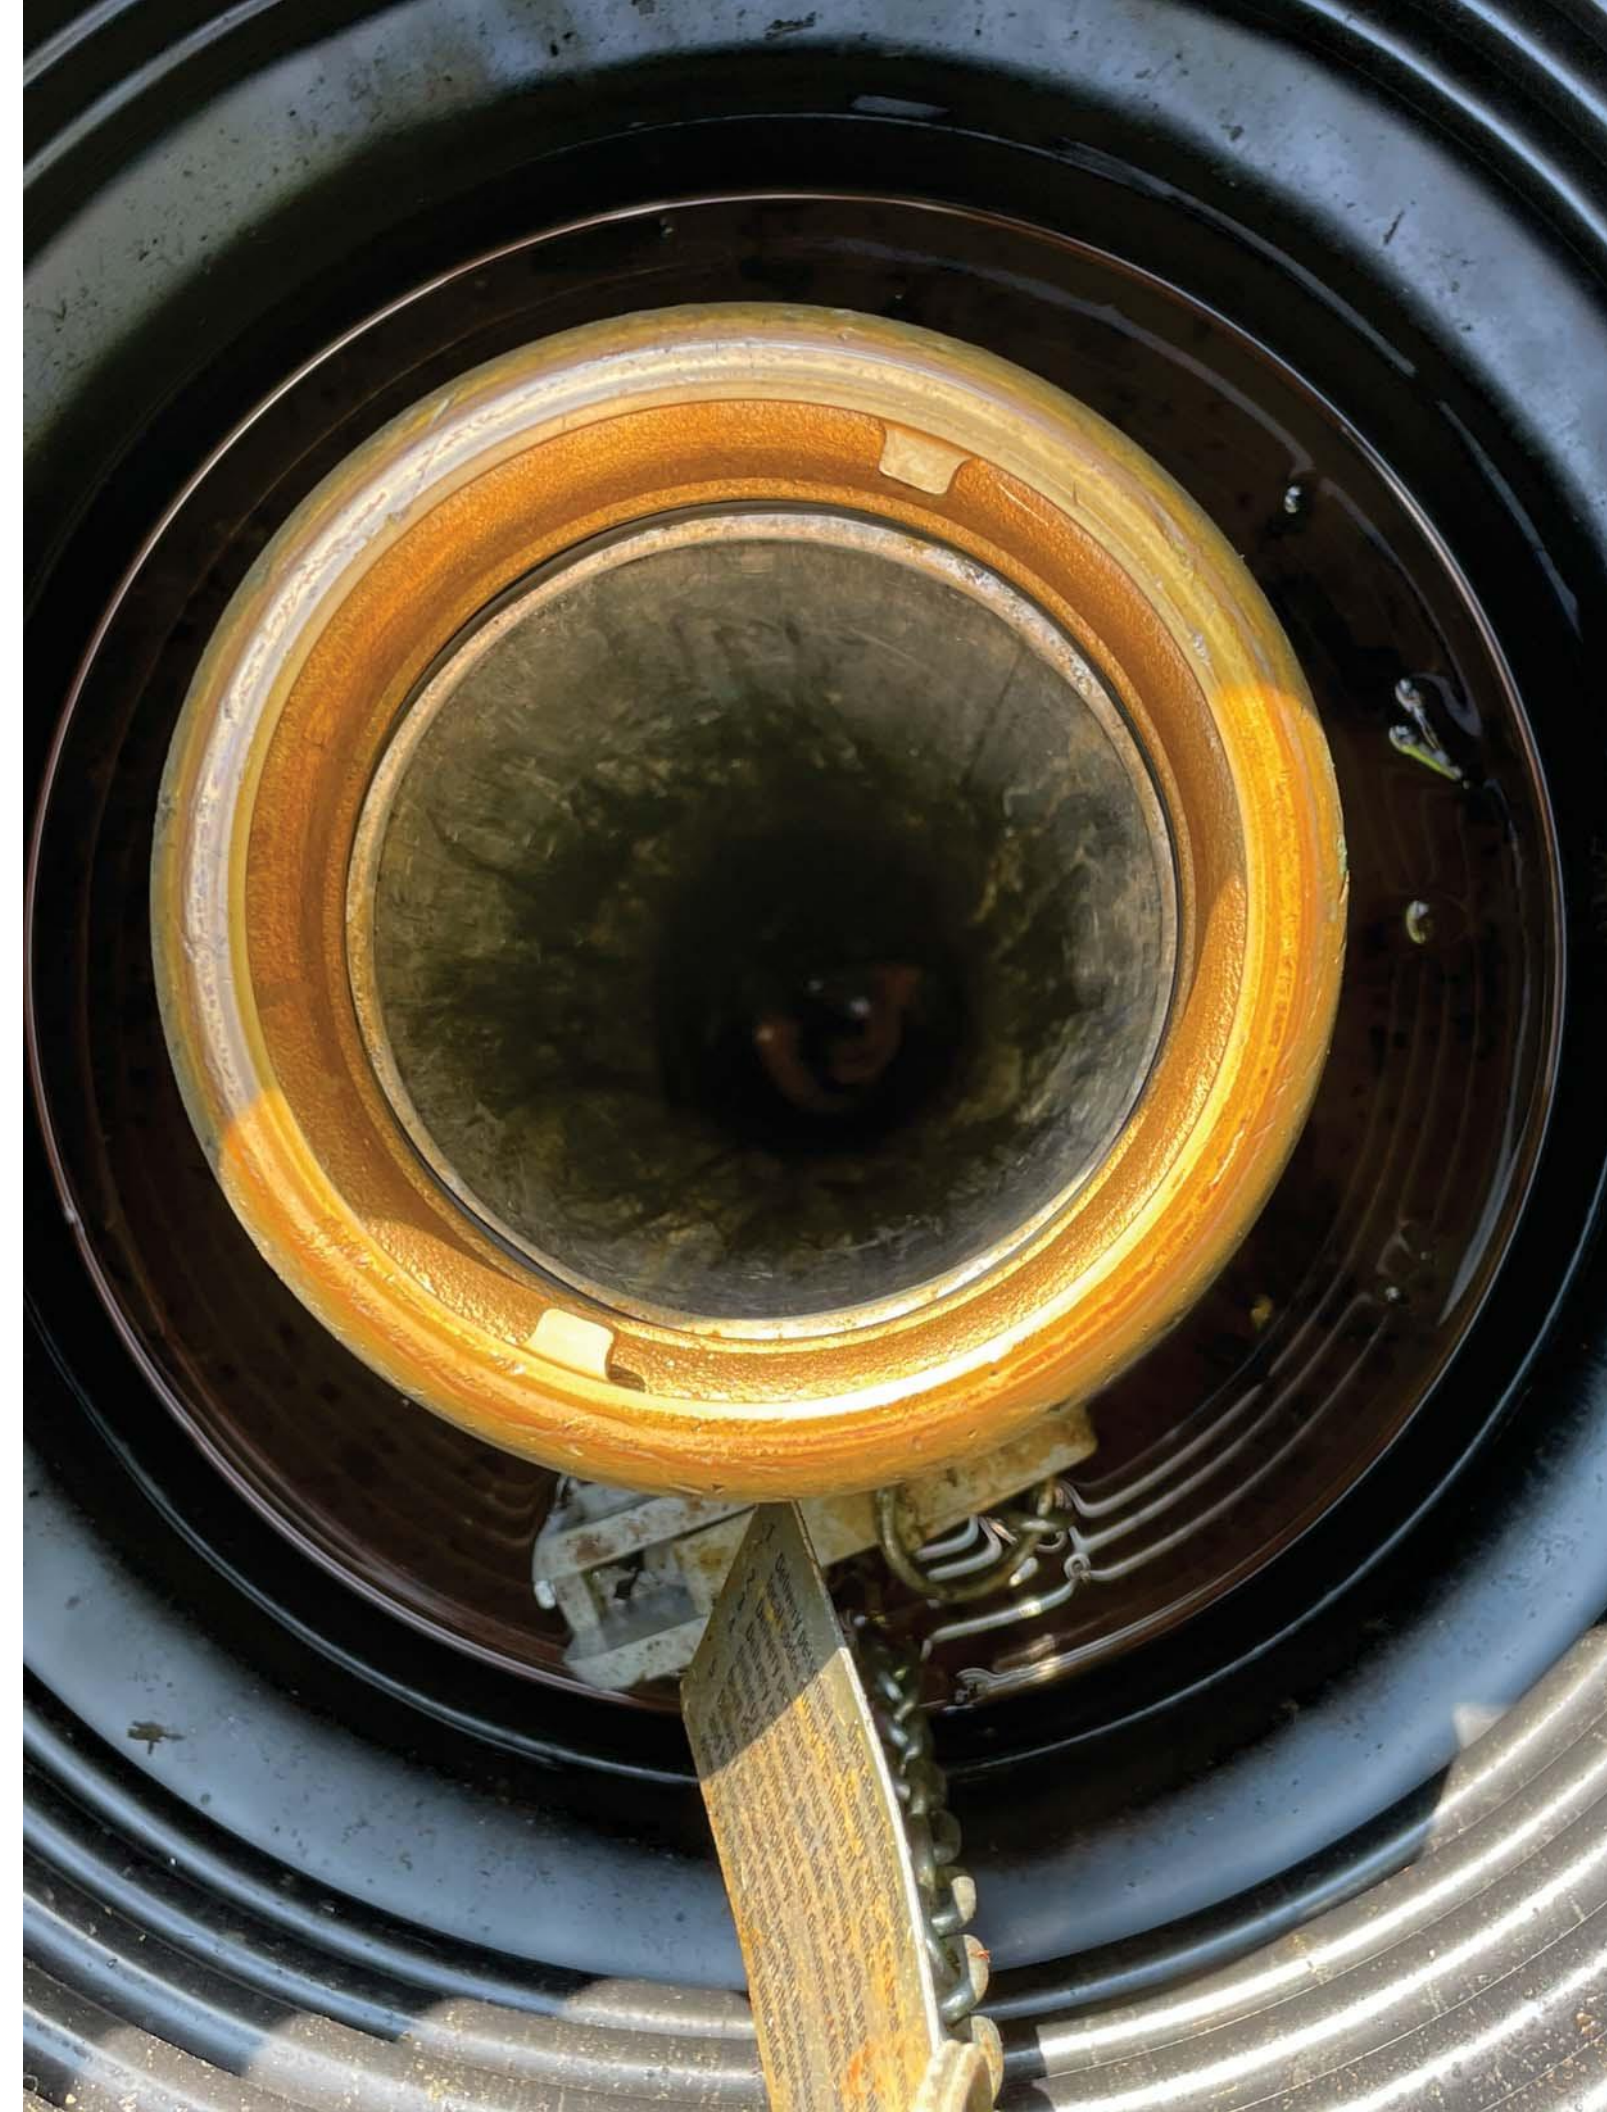









62

63

64

65













DOVER
CORP.
MADE IN TAIN

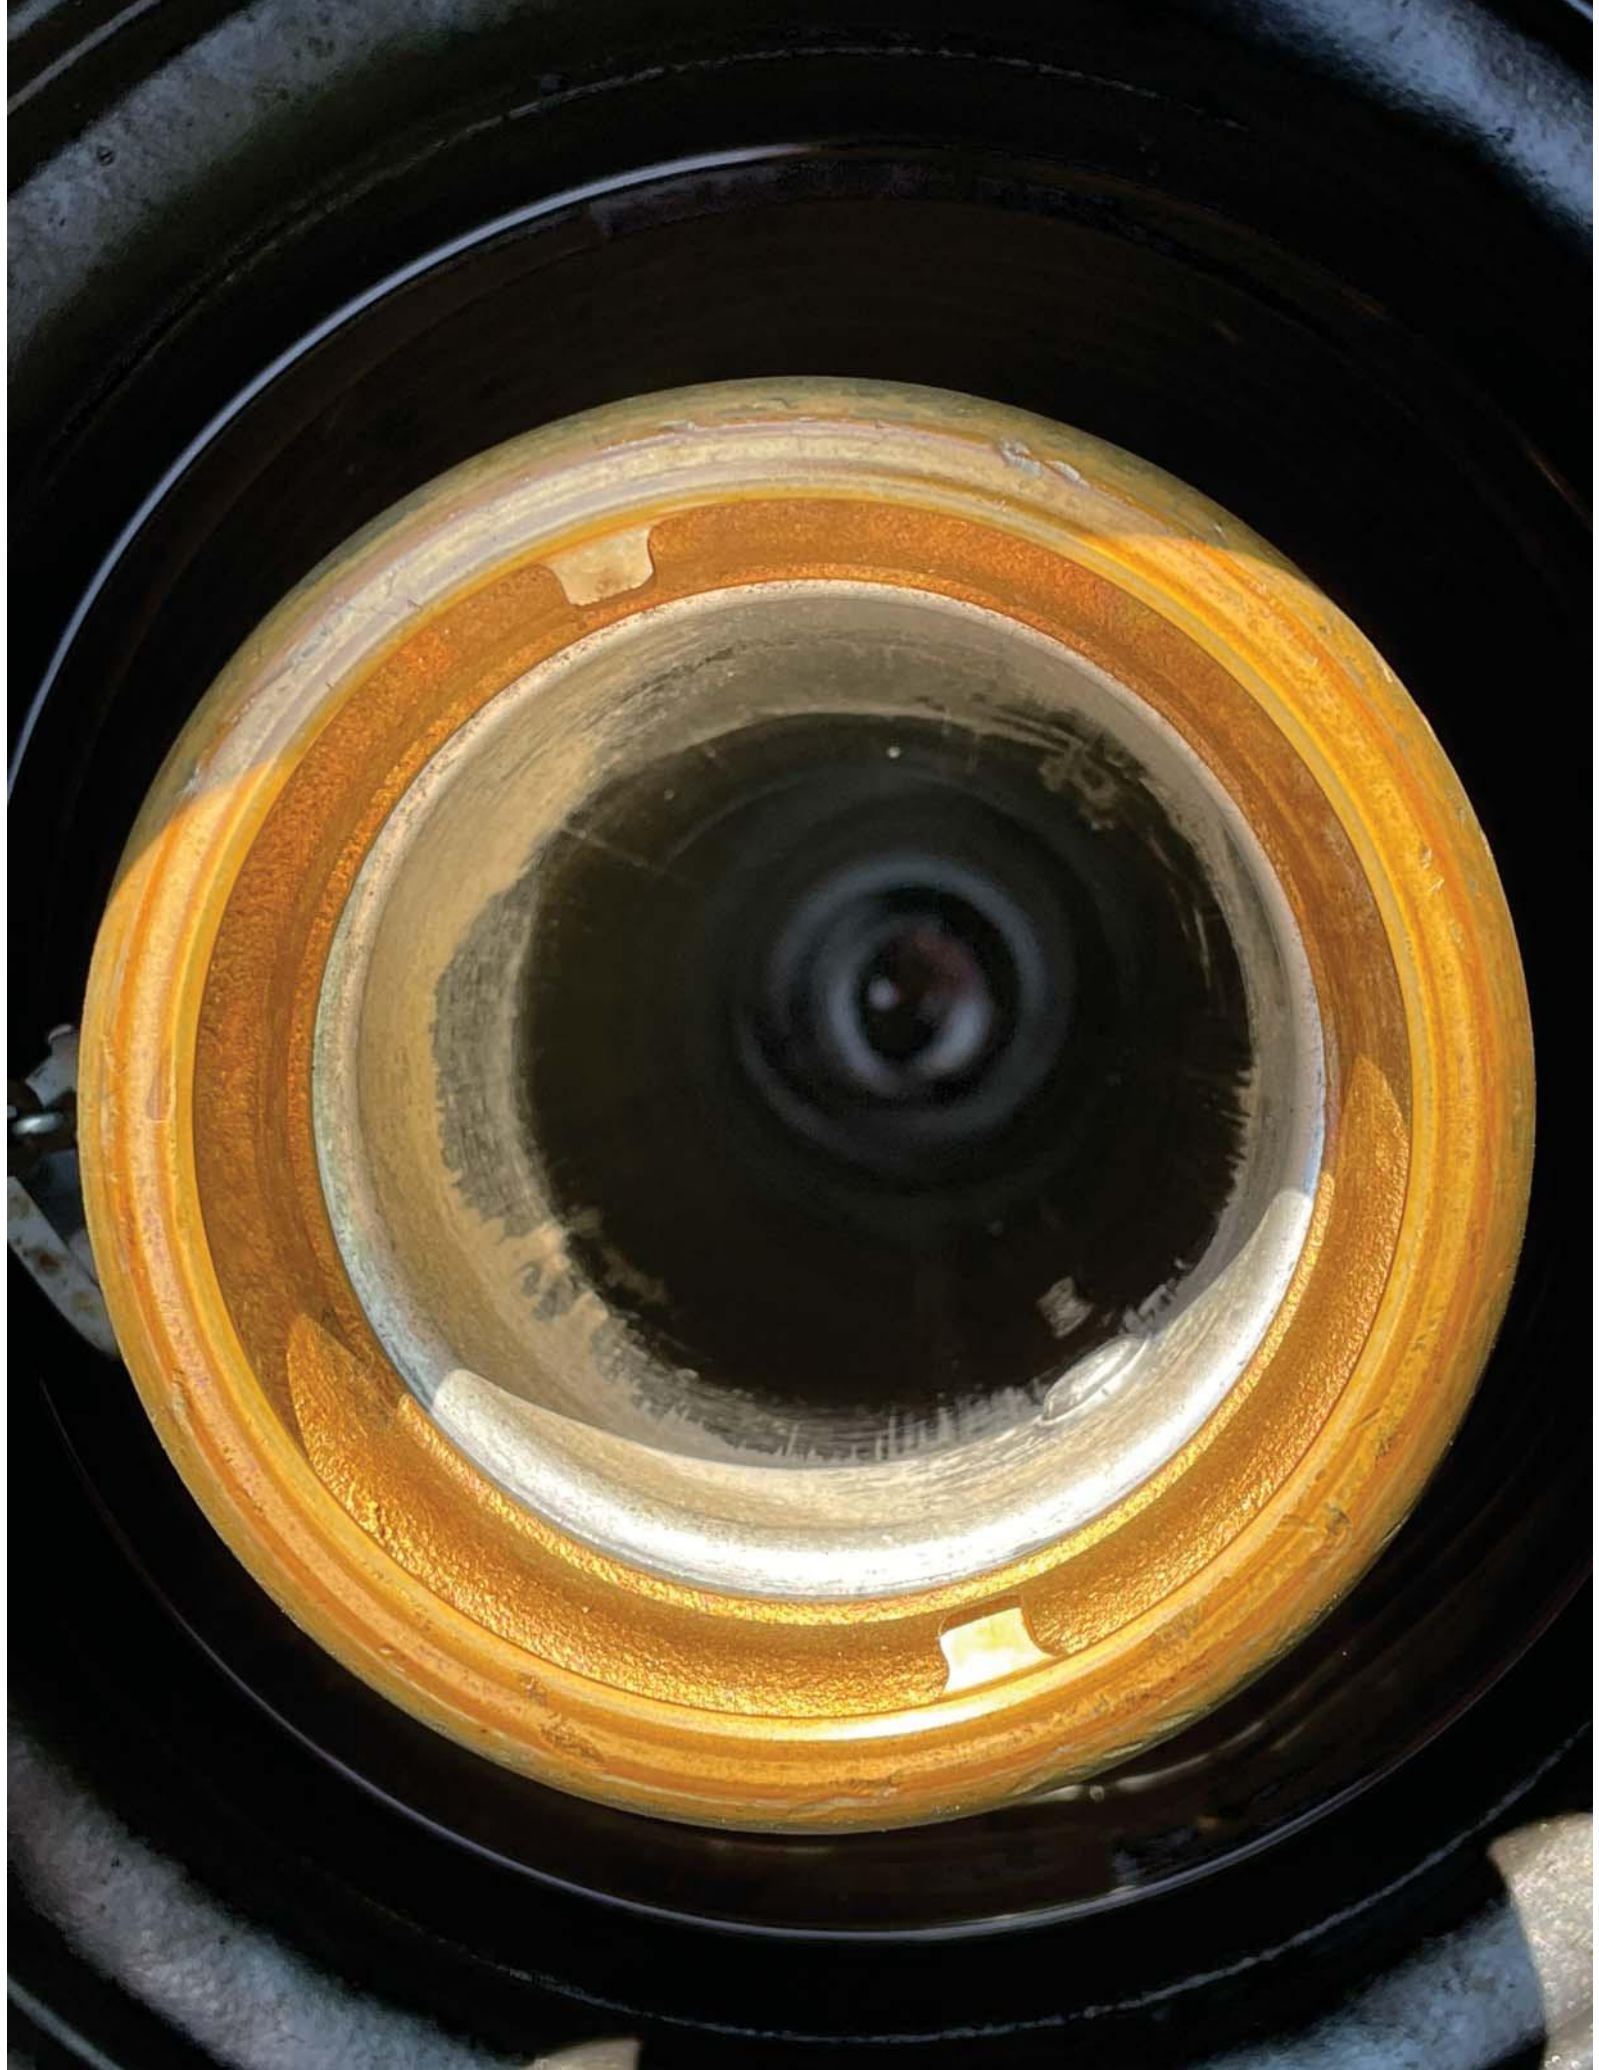





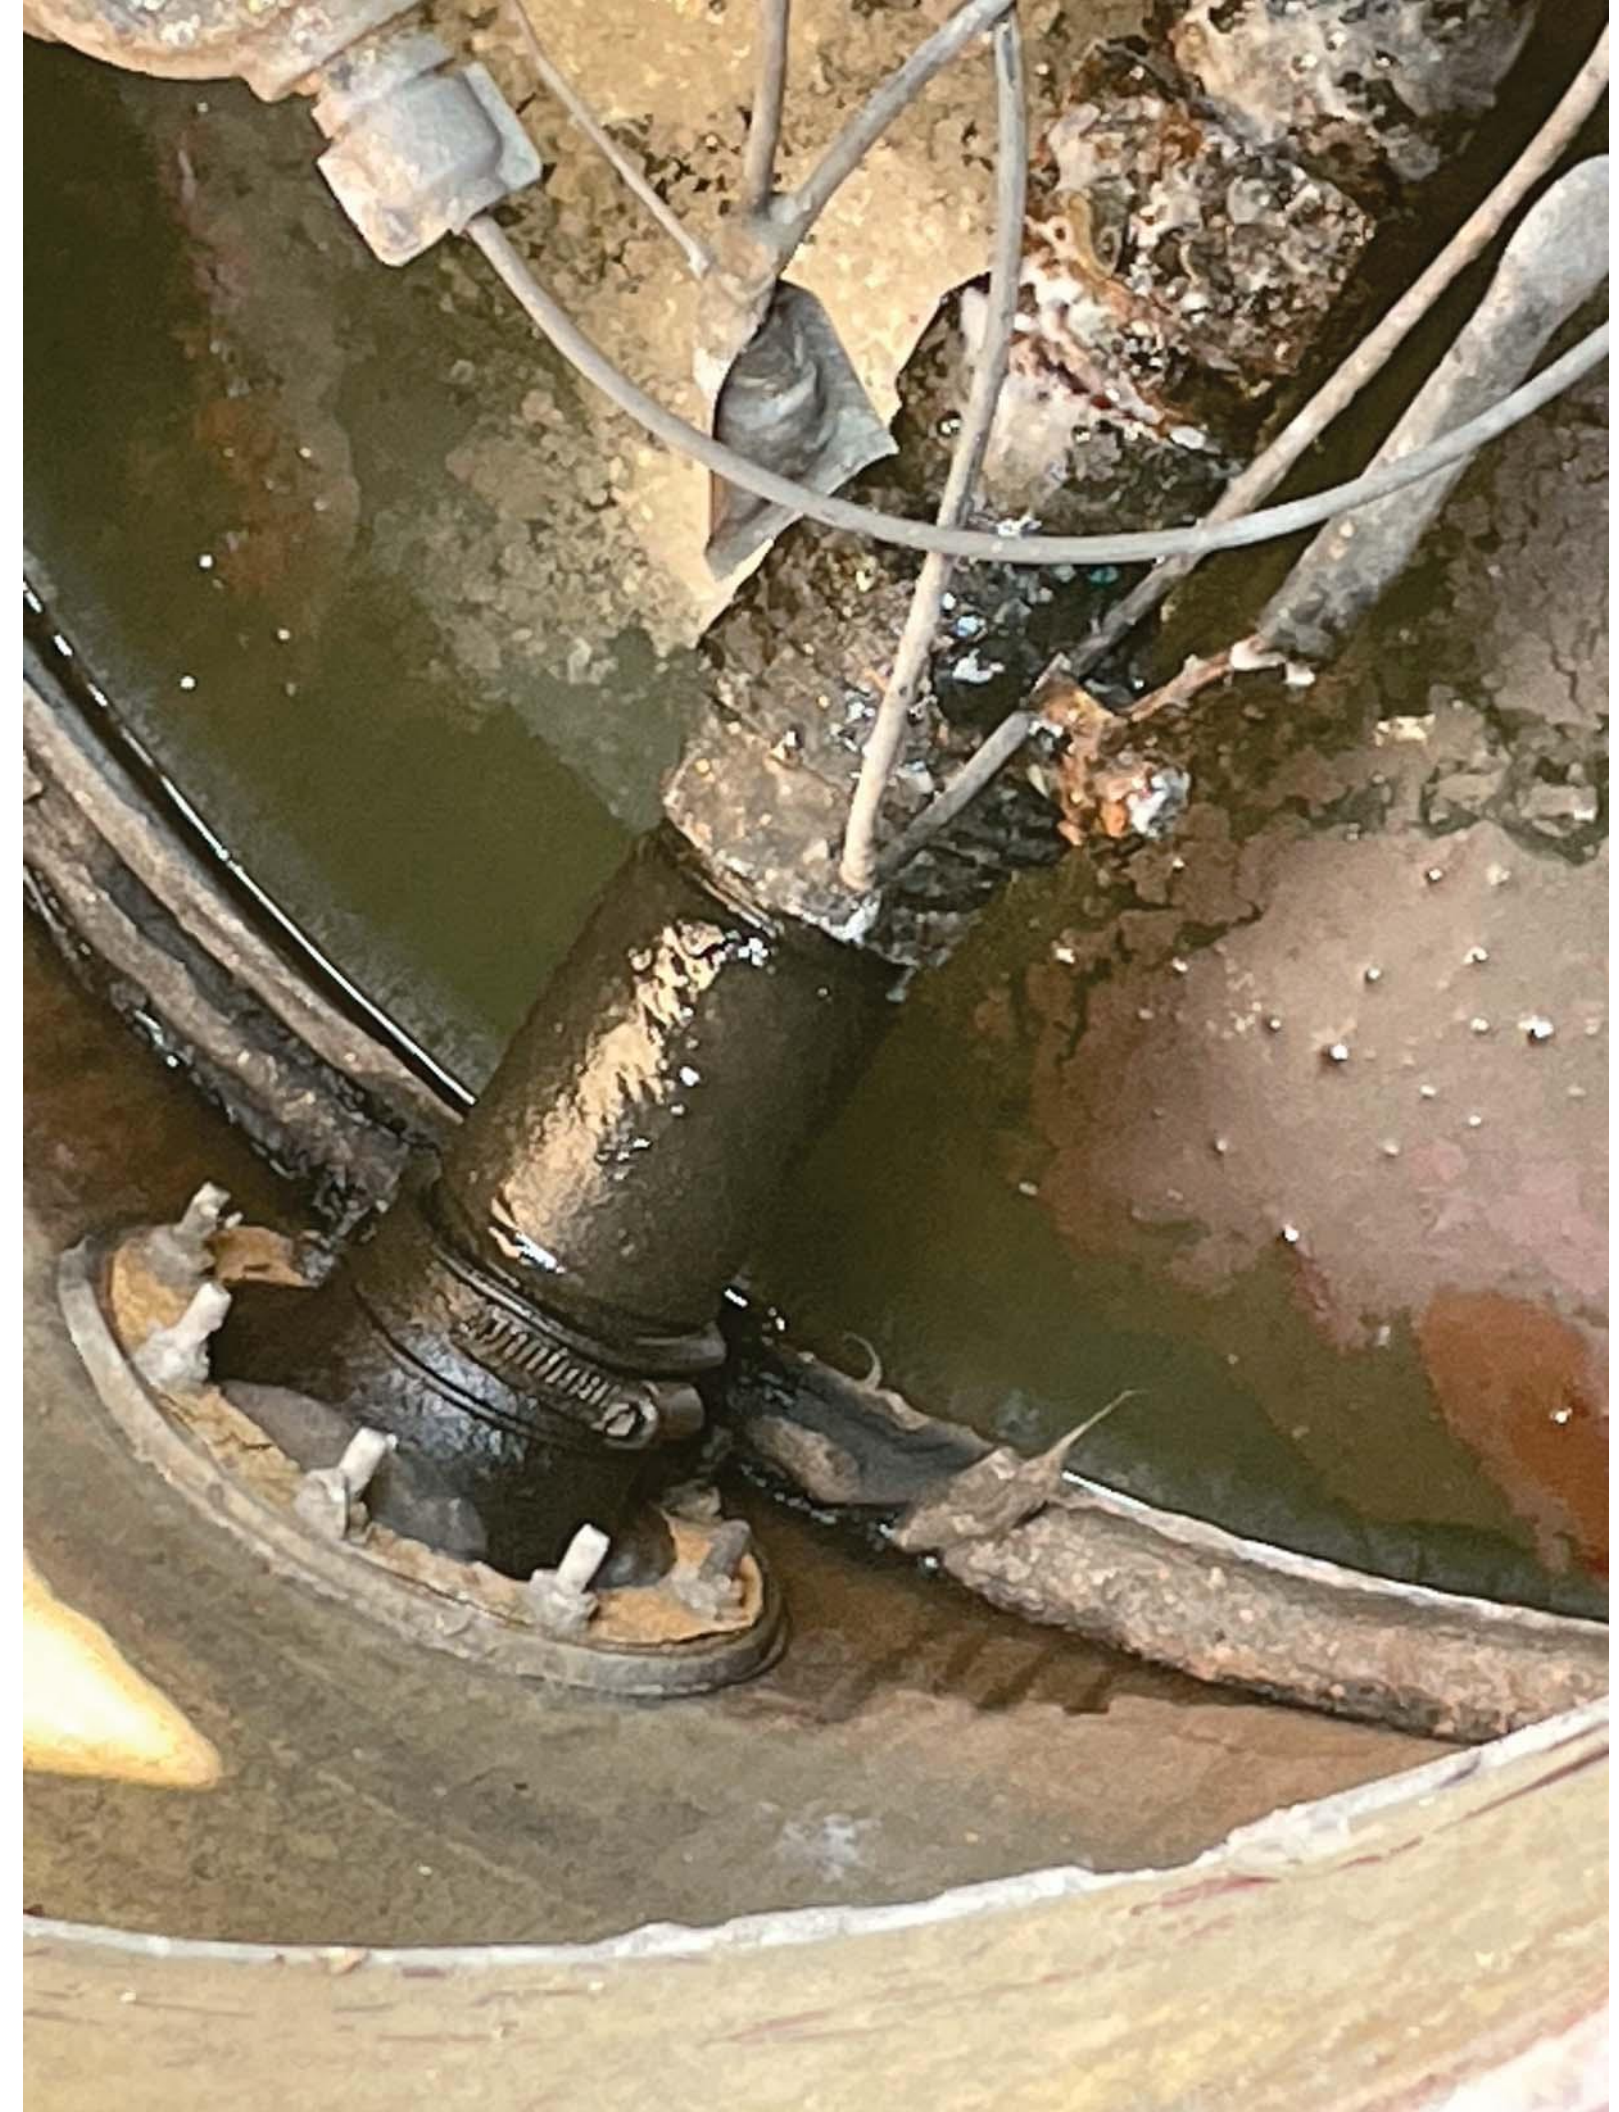



Mobil

Exxon Mobil
Automatic
rewards with
every fill-up

Play back Base and push savings on autopilot
with the Exxon Mobil Rewards+ app



For your safety

- ⚡ (No open flames)
- 🚫 (No smoking)
- 🚫 (No drinking)
- 🚫 (No eating)
- 🚫 (No cell phone use while refueling)
- 🚫 (No refueling with a full tank)
- 🚫 (No refueling with a hot engine)
- 🚫 (No refueling with a leaking fuel system)
- 🚫 (No refueling with a damaged fuel system)
- 🚫 (No refueling with a damaged fuel tank)
- 🚫 (No refueling with a damaged fuel pump)
- 🚫 (No refueling with a damaged fuel nozzle)
- 🚫 (No refueling with a damaged fuel hose)
- 🚫 (No refueling with a damaged fuel gun)
- 🚫 (No refueling with a damaged fuel handle)
- 🚫 (No refueling with a damaged fuel nozzle cover)
- 🚫 (No refueling with a damaged fuel nozzle tip)
- 🚫 (No refueling with a damaged fuel nozzle seal)
- 🚫 (No refueling with a damaged fuel nozzle O-ring)
- 🚫 (No refueling with a damaged fuel nozzle spring)
- 🚫 (No refueling with a damaged fuel nozzle latch)
- 🚫 (No refueling with a damaged fuel nozzle lock)
- 🚫 (No refueling with a damaged fuel nozzle release button)
- 🚫 (No refueling with a damaged fuel nozzle handle)
- 🚫 (No refueling with a damaged fuel nozzle trigger)
- 🚫 (No refueling with a damaged fuel nozzle nozzle)
- 🚫 (No refueling with a damaged fuel nozzle tip)
- 🚫 (No refueling with a damaged fuel nozzle seal)
- 🚫 (No refueling with a damaged fuel nozzle O-ring)
- 🚫 (No refueling with a damaged fuel nozzle spring)
- 🚫 (No refueling with a damaged fuel nozzle latch)
- 🚫 (No refueling with a damaged fuel nozzle lock)
- 🚫 (No refueling with a damaged fuel nozzle release button)
- 🚫 (No refueling with a damaged fuel nozzle handle)
- 🚫 (No refueling with a damaged fuel nozzle trigger)
- 🚫 (No refueling with a damaged fuel nozzle nozzle)

Purchase \$ 10.00
Gallons 26.32

Regular 87
Extra 89
Supreme+ 93

1

FUEL TECHNOLOGY
Synergy
Mobil


Podiatric & Family Dentistry

Mobil
Car Wash
10.00

Synergy

Mobil

Exxon

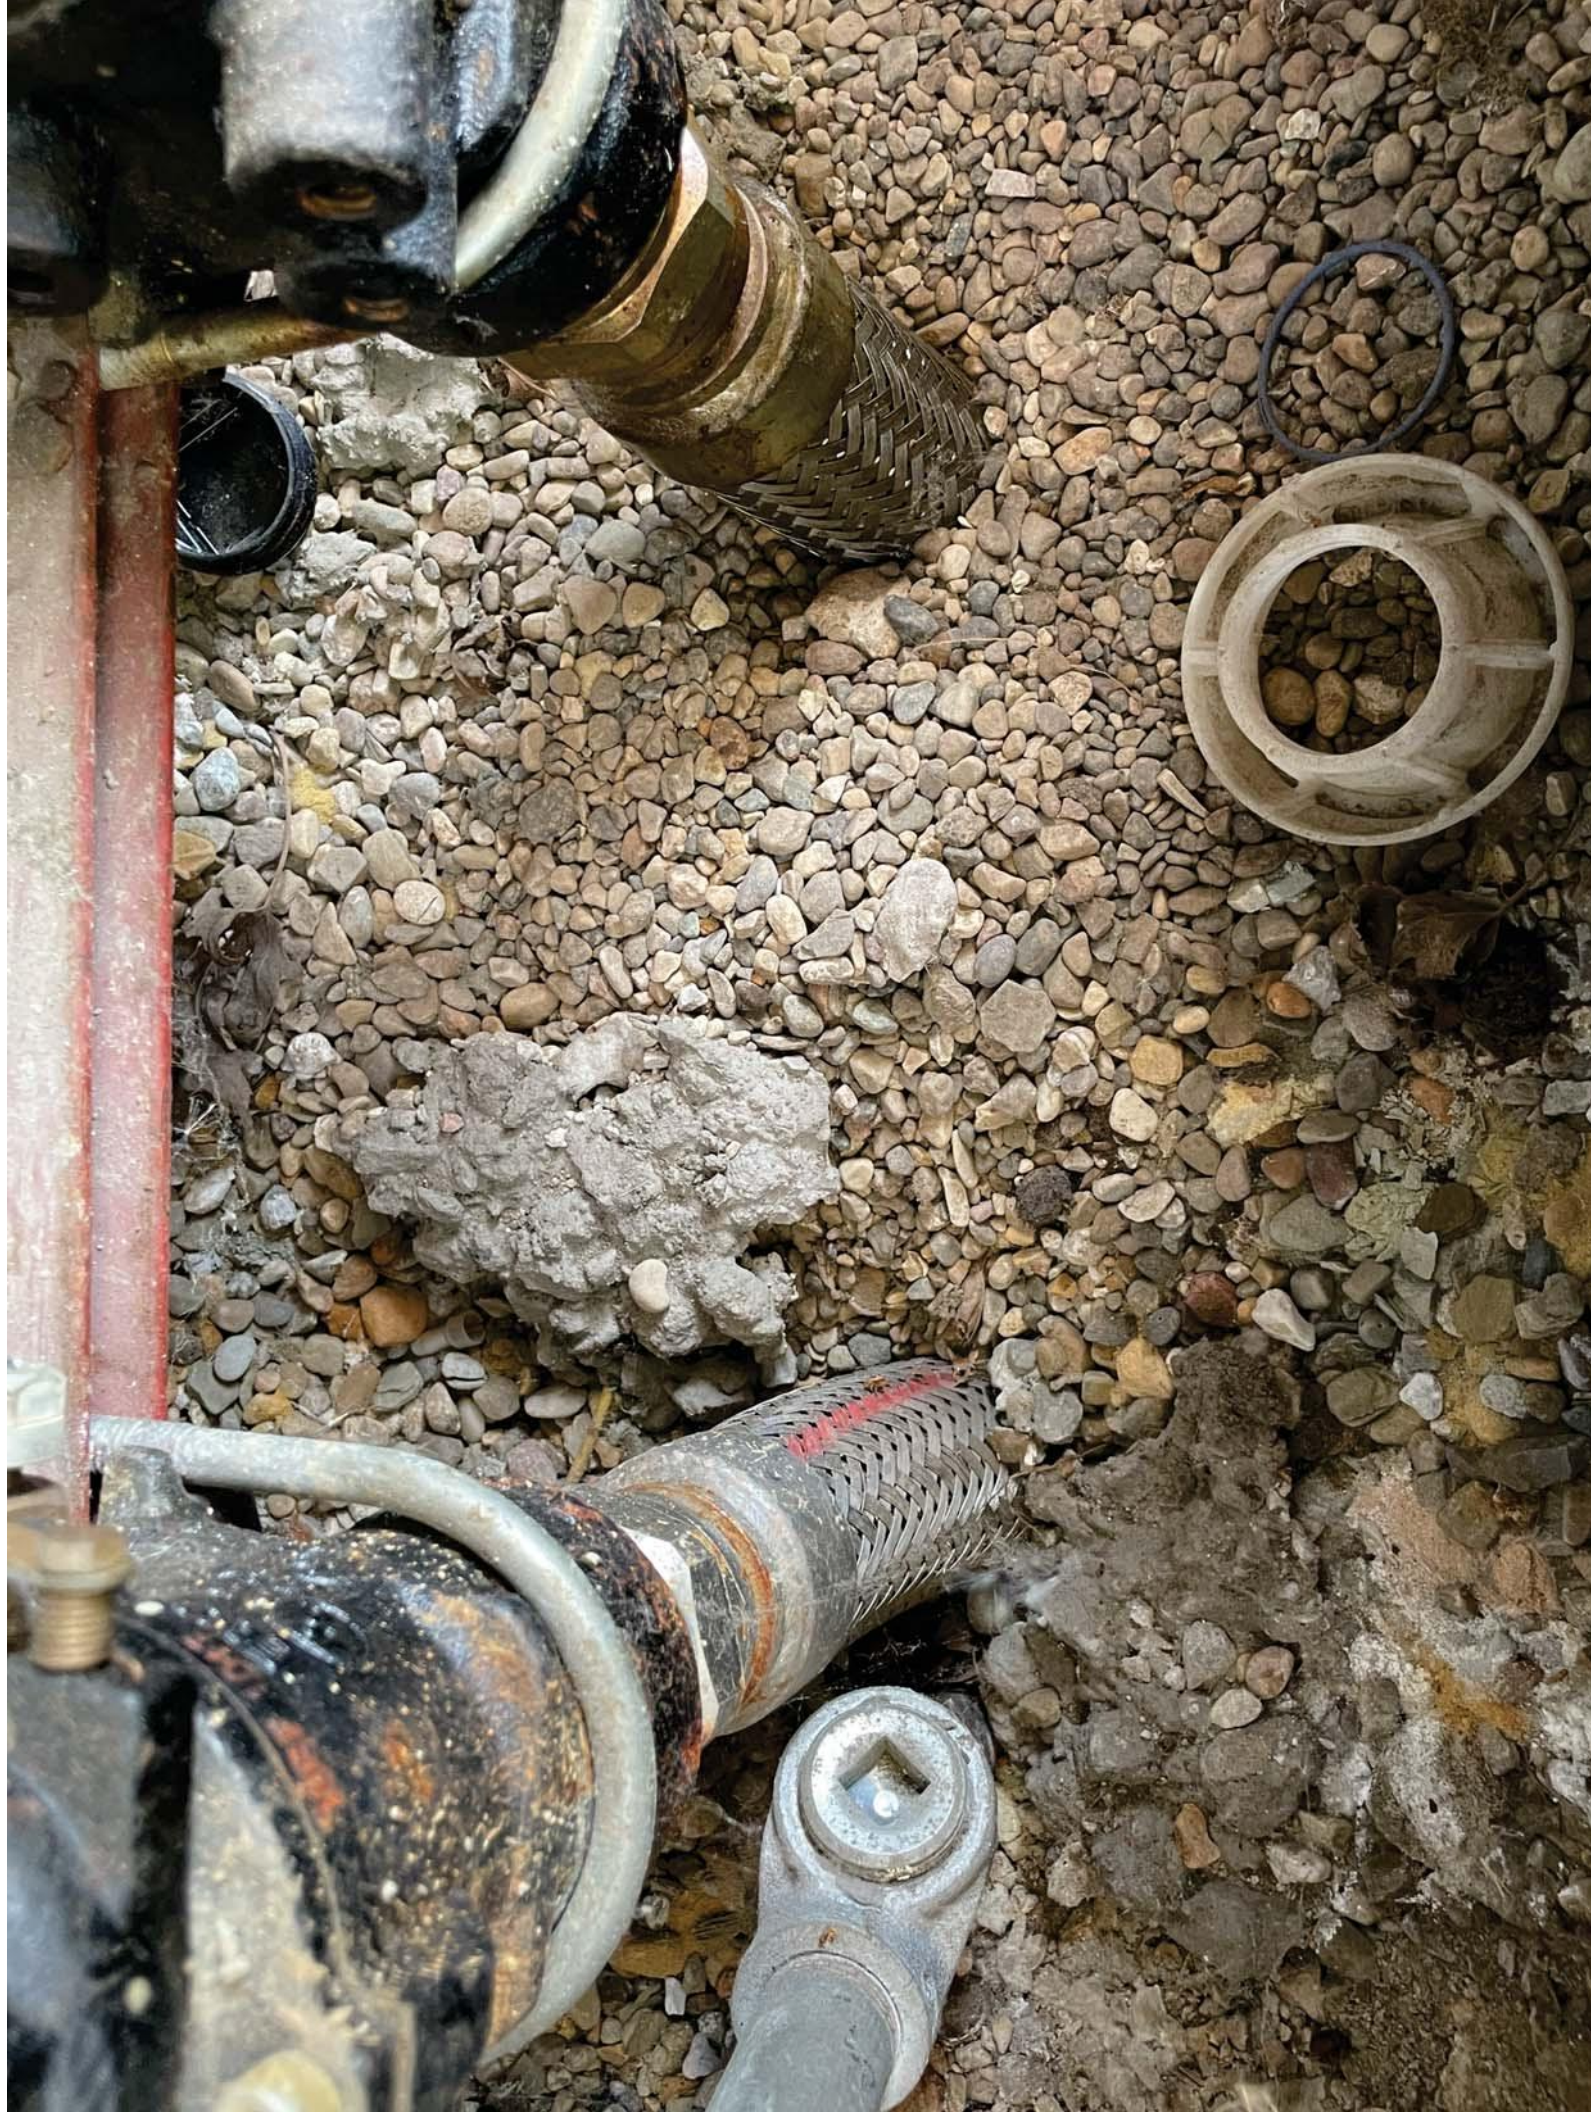



Mobil

Car Wash
Synergy



Purchase \$ 30.00
Gallons 62.51

PLEASE
PAY
FIRST


Regular 87
Extra 89
Supreme+ 93



FUEL TECHNOLOGY Synergy™

Mobil

EXXON Mobil
rewards
Autoload
rewards with
every fill-up



For your safety



AARP member
benefit

For your safety
EXXON MOBIL
rewards

EXXON MOBIL





Mobil

Special Deal
7¢ OFF
Crystal Data
Employee

Purchase \$ 10.00
Gallons 20.03

PLEASE
PAY
FIRST

Regular	Extra	Supreme [®]
1.89	2.09	2.29
87	89	93

FUEL TECHNOLOGY
Synergy
Mobil


Exxon Mobil
Automatic rewards with every fill-up
Pay through your MFD just savings on gas with the Exxon Mobil Rewards+™ app.


For your safety

- ⚠️ No smoking
- ⚠️ No open flames
- ⚠️ No eating or drinking
- ⚠️ No children
- ⚠️ No pets
- ⚠️ No cell phone use
- ⚠️ No alcohol
- ⚠️ No firearms
- ⚠️ No weapons
- ⚠️ No drugs
- ⚠️ No illegal activities

AARP member

Exxon Mobil

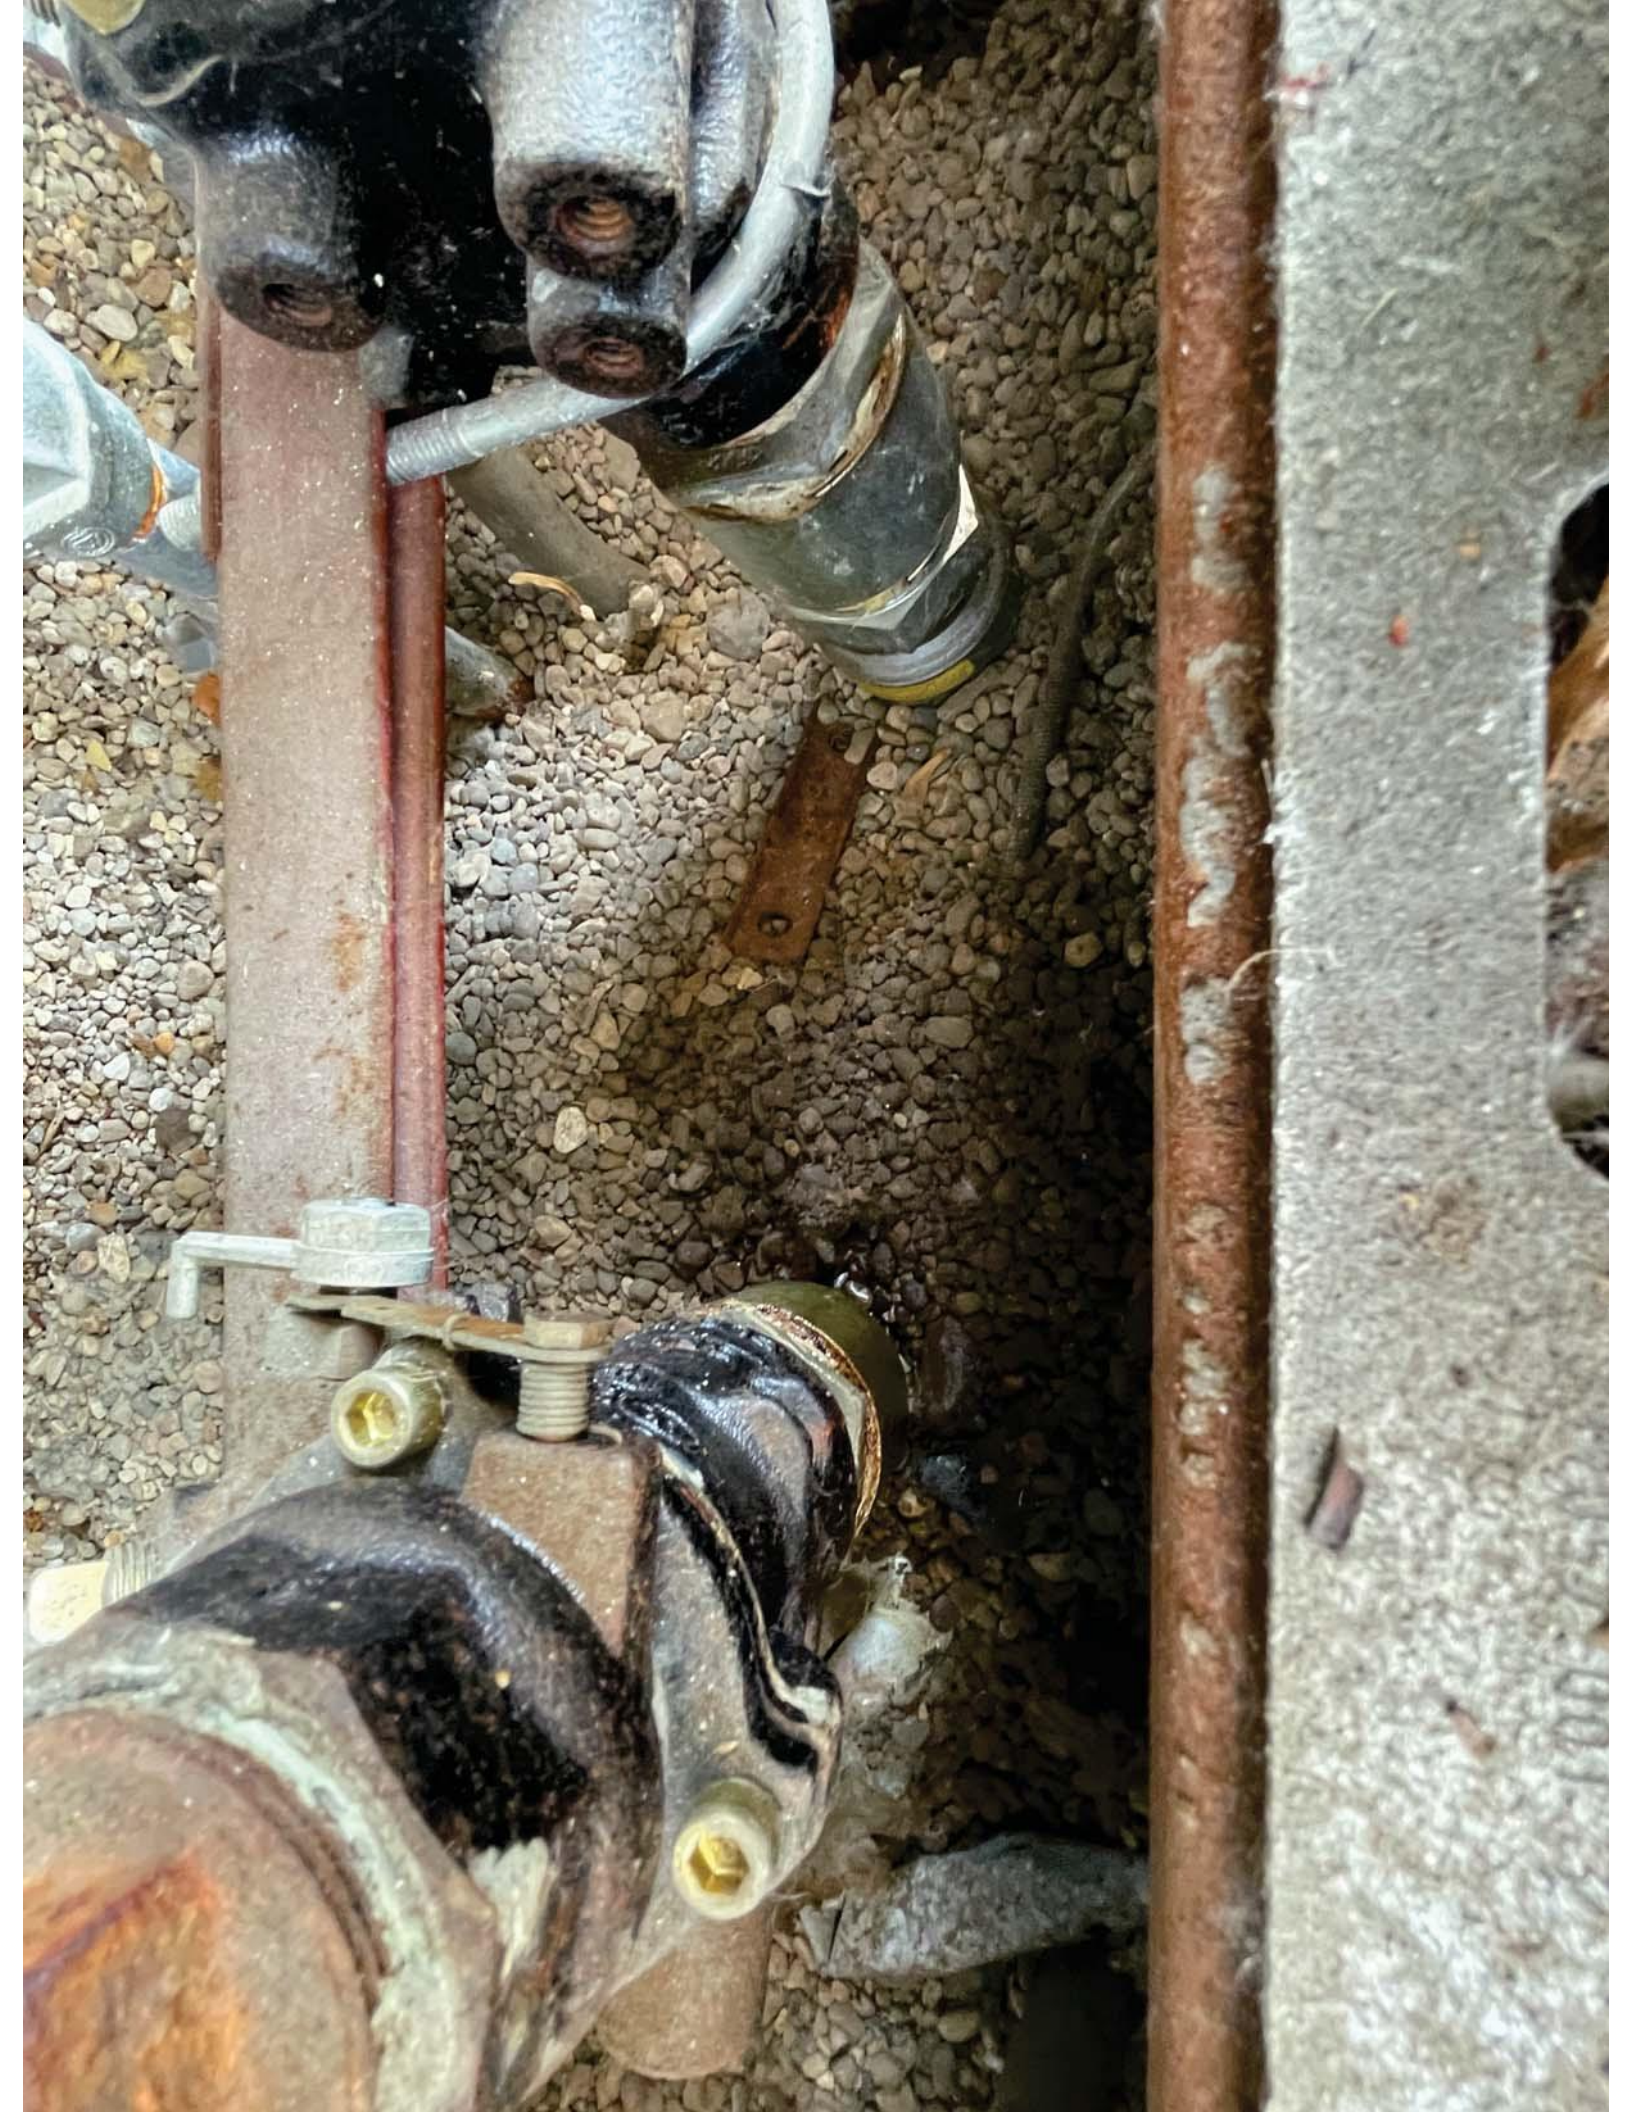

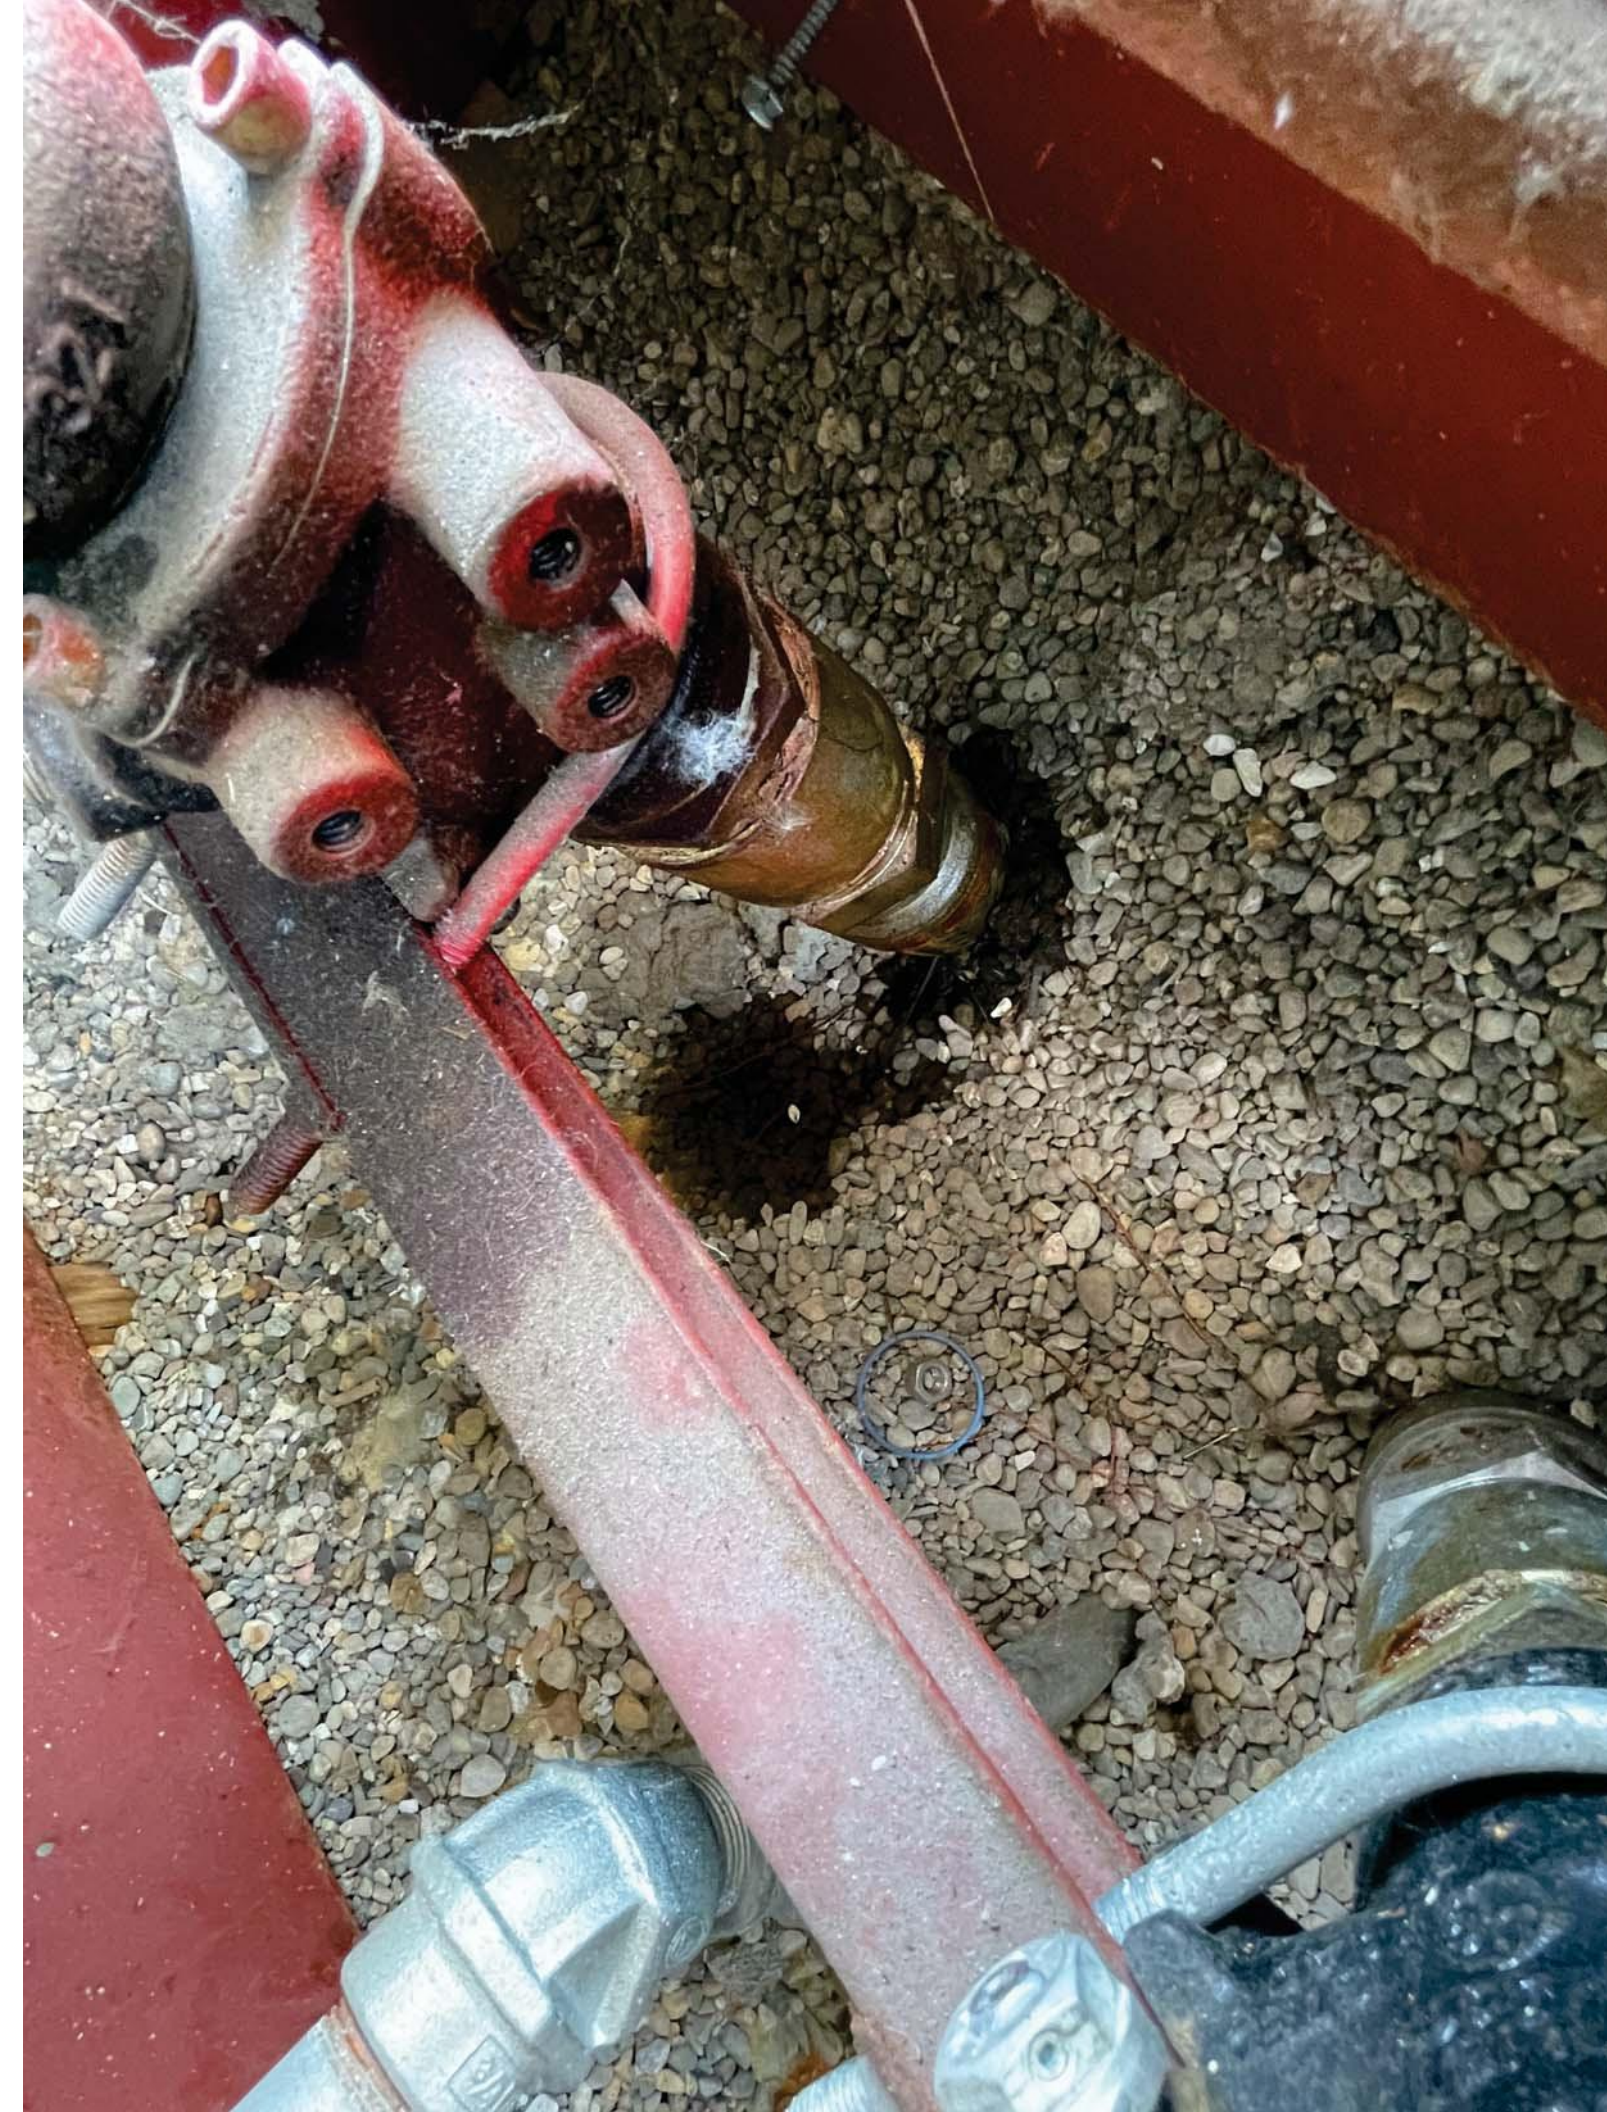





Mobil

0 am

CLEARANCE
9' 0"

Godfather's
Pizza Express



Purchase 20.00
Gallons 52.65

7

PLEASE
PAY
FIRST

Regular 87
Extra 89
Supreme+ 93

CONTAIN UP TO
10% ETHANOL



FUEL TECHNOLOGY Synergy™

Mobil

Exxon Mobil
Automatic
rewards with
every fill-up



Fill
feels
when
with




AARP mem

Exxon Mobil





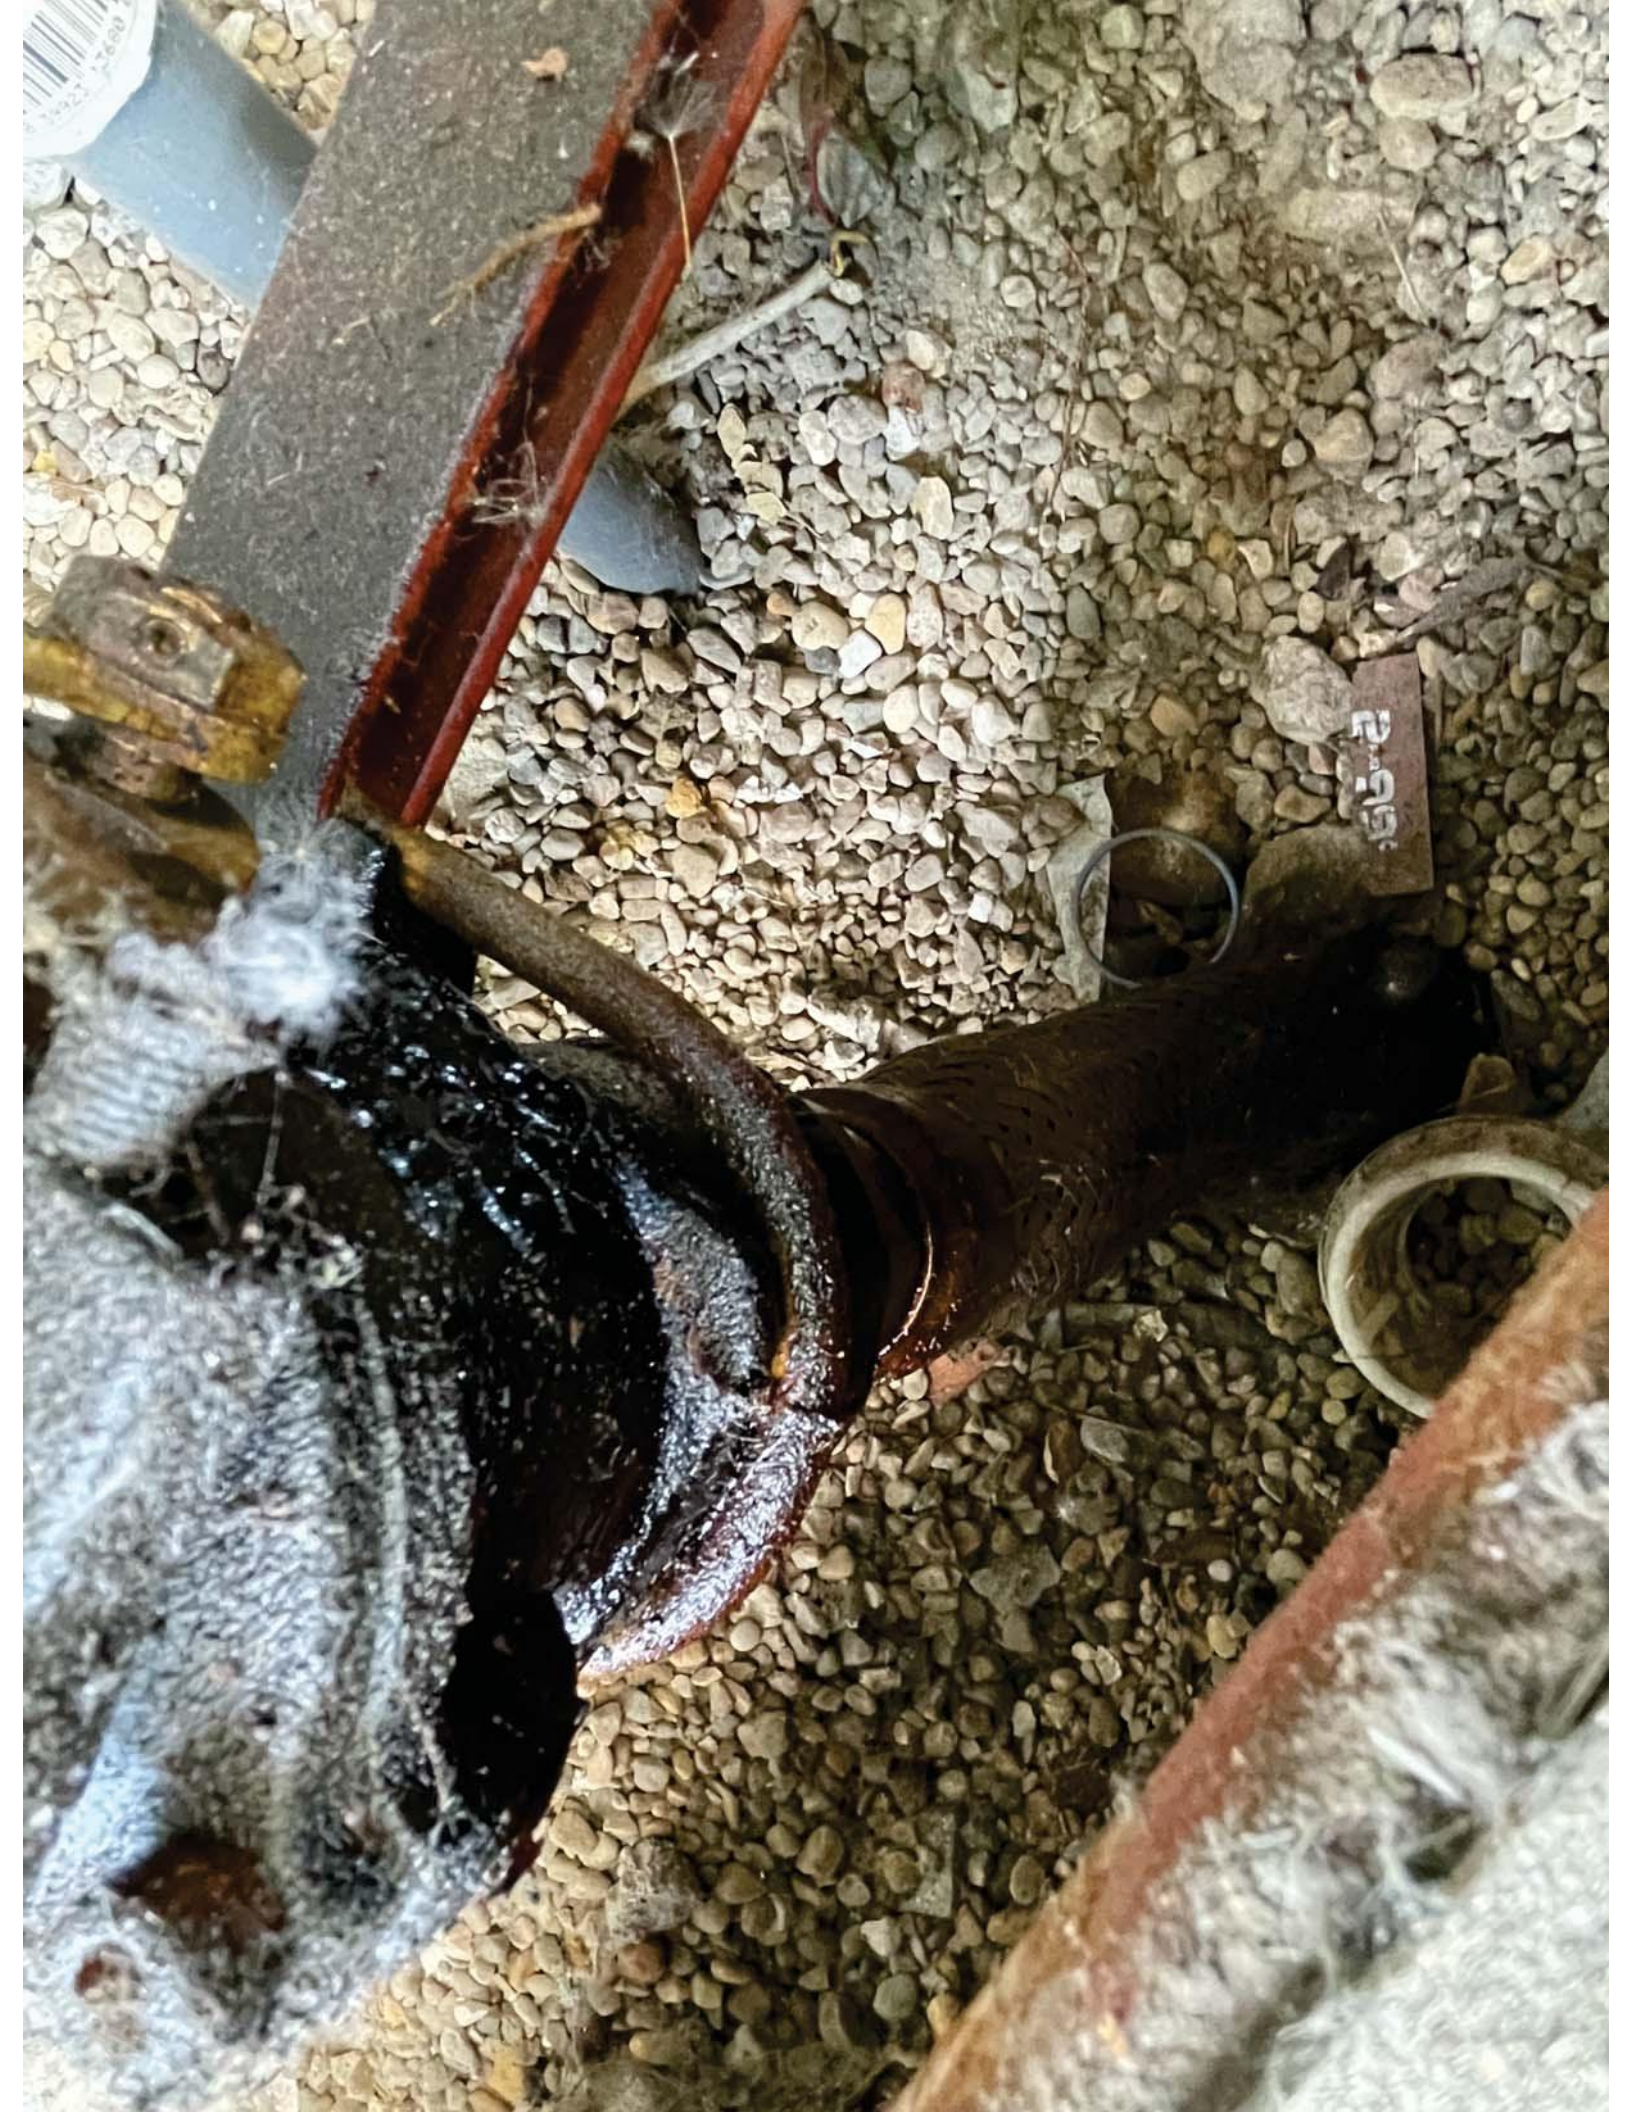

GO LO
6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:01
SYSTEM STATUS REPORT
ALL FUNCTIONS NORMAL
INVENTORY REPORT
T 1:REGULAR
VOLUME = 4713 GALS
ULLAGE = 5850 GALS
90% ULLAGE = 4793 GALS
TC VOLUME = 4672 GALS
HEIGHT = 54.80 INCHES
WATER VOL = 0 GALS
WATER = 0.00 INCHES
TEMP = 72.2 DEG F
T 2:REG SLAVE
VOLUME = 4733 GALS
ULLAGE = 1647 GALS
90% ULLAGE = 1009 GALS
TC VOLUME = 4694 GALS
HEIGHT = 82.86 INCHES
WATER VOL = 0 GALS
WATER = 0.00 INCHES
TEMP = 71.7 DEG F
T 3:PREMIUM
VOLUME = 1653 GALS
ULLAGE = 4727 GALS
90% ULLAGE = 4089 GALS
TC VOLUME = 1642 GALS
HEIGHT = 36.25 INCHES
WATER VOL = 4 GALS
WATER = 0.64 INCHES
TEMP = 69.7 DEG F
MANIFOLDED TANKS
INVENTORY TOTALS
T 1:REGULAR
VOLUME = 9446 GALS
TC VOLUME = 9366 GALS
***** END *****

GO LO
6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:02
TANK LEAK TEST HISTORY
T 1:REGULAR
LAST GROSS TEST PASSED:
JUN 20, 2024 5:48
STARTING VOLUME = 4740
PERCENT VOLUME = 44.9
TEST TYPE = STANDARD
LAST ANNUAL TEST PASSED:
NO TEST PASSED
FULLEST ANNUAL TEST PASS
NO TEST PASSED
LAST PERIODIC TEST PASS:
JUN 20, 2024 6:23
TEST LENGTH 18 HOURS
STARTING VOLUME = 3945
PERCENT VOLUME = 37.4
TEST TYPE = CSLD
FULLEST PERIODIC TEST
PASSED EACH MONTH:
JAN 30, 2024 5:43
TEST LENGTH 21 HOURS
STARTING VOLUME = 4736
PERCENT VOLUME = 44.8
TEST TYPE = CSLD
FEB 29, 2024 8:00
TEST LENGTH 16 HOURS
STARTING VOLUME = 5305
PERCENT VOLUME = 50.2
TEST TYPE = CSLD
MAR 10, 2024 21:08
TEST LENGTH 16 HOURS
STARTING VOLUME = 5330
PERCENT VOLUME = 50.5
TEST TYPE = CSLD
APR 27, 2024 6:33
TEST LENGTH 20 HOURS
STARTING VOLUME = 5309
PERCENT VOLUME = 50.3
TEST TYPE = CSLD
MAY 1, 2024 1:48
TEST LENGTH 19 HOURS
STARTING VOLUME = 6228
PERCENT VOLUME = 49.5
TEST TYPE = CSLD
JUN 20, 2024 6:23
TEST LENGTH 18 HOURS
STARTING VOLUME = 3945
PERCENT VOLUME = 37.4
TEST TYPE = CSLD
JUL 21, 2023 3:15
TEST LENGTH 25 HOURS
STARTING VOLUME = 4585
PERCENT VOLUME = 43.4
TEST TYPE = CSLD
AUG 2, 2023 8:00
TEST LENGTH 24 HOURS
STARTING VOLUME = 4072
PERCENT VOLUME = 38.6
TEST TYPE = CSLD
SEP 3, 2023 6:21
TEST LENGTH 20 HOURS
STARTING VOLUME = 3567
PERCENT VOLUME = 33.8
TEST TYPE = CSLD
OCT 10, 2023 4:57
TEST LENGTH 21 HOURS
STARTING VOLUME = 3598
PERCENT VOLUME = 35.0
TEST TYPE = CSLD
NOV 24, 2023 7:10
TEST LENGTH 26 HOURS
STARTING VOLUME = 4491
PERCENT VOLUME = 42.5
TEST TYPE = CSLD
DEC 12, 2023 6:56
TEST LENGTH 22 HOURS
STARTING VOLUME = 4816
PERCENT VOLUME = 45.6
TEST TYPE = CSLD
***** END *****

6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:02
TANK LEAK TEST HISTORY
T 2:REG SLAVE
LAST GROSS TEST PASSED:
JUN 20, 2024 5:48
STARTING VOLUME = 4745
PERCENT VOLUME = 74.4
TEST TYPE = STANDARD
LAST ANNUAL TEST PASSED:
NO TEST PASSED
FULLEST ANNUAL TEST PASS
NO TEST PASSED
LAST PERIODIC TEST PASS:
JUN 20, 2024 6:23
TEST LENGTH 17 HOURS
STARTING VOLUME = 4712
PERCENT VOLUME = 73.9
TEST TYPE = CSLD
FULLEST PERIODIC TEST
PASSED EACH MONTH:
JAN 30, 2024 5:43
TEST LENGTH 19 HOURS
STARTING VOLUME = 5221
PERCENT VOLUME = 81.8
TEST TYPE = CSLD
FEB 7, 2024 21:47
TEST LENGTH 13 HOURS
STARTING VOLUME = 5422
PERCENT VOLUME = 85.0
TEST TYPE = CSLD
MAR 29, 2024 23:47
TEST LENGTH 21 HOURS
STARTING VOLUME = 5262
PERCENT VOLUME = 82.5
TEST TYPE = CSLD
APR 6, 2024 4:00
TEST LENGTH 16 HOURS
STARTING VOLUME = 5713
PERCENT VOLUME = 87.3
TEST TYPE = CSLD
MAY 14, 2024 4:12
TEST LENGTH 15 HOURS
STARTING VOLUME = 5236
PERCENT VOLUME = 82.1
TEST TYPE = CSLD
JUN 20, 2024 9:50
TEST LENGTH 14 HOURS
STARTING VOLUME = 4755
PERCENT VOLUME = 74.5
TEST TYPE = CSLD
JUL 6, 2023 3:45
TEST LENGTH 16 HOURS
STARTING VOLUME = 5060
PERCENT VOLUME = 79.3
TEST TYPE = CSLD
AUG 2, 2023 8:00
TEST LENGTH 15 HOURS
STARTING VOLUME = 4932
PERCENT VOLUME = 77.9
TEST TYPE = CSLD
SEP 11, 2023 8:00
TEST LENGTH 16 HOURS
STARTING VOLUME = 4269
PERCENT VOLUME = 66.9
TEST TYPE = CSLD
OCT 30, 2023 2:04
TEST LENGTH 15 HOURS
STARTING VOLUME = 4577
PERCENT VOLUME = 71.7
TEST TYPE = CSLD
NOV 30, 2023 2:15
TEST LENGTH 21 HOURS
STARTING VOLUME = 5308
PERCENT VOLUME = 83.2
TEST TYPE = CSLD
DEC 2, 2023 0:42
TEST LENGTH 24 HOURS
STARTING VOLUME = 5419
PERCENT VOLUME = 84.9
TEST TYPE = CSLD
***** END *****

GO LO
6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:02
TANK LEAK TEST HISTORY
T 3:PREMIUM
LAST GROSS TEST PASSED:
JUN 20, 2024 6:40
STARTING VOLUME = 1650
PERCENT VOLUME = 25.9
TEST TYPE = STANDARD
LAST ANNUAL TEST PASSED:
NO TEST PASSED
FULLEST ANNUAL TEST PASS
NO TEST PASSED
LAST PERIODIC TEST PASS:
JUN 20, 2024 7:34
TEST LENGTH 31 HOURS
STARTING VOLUME = 1663
PERCENT VOLUME = 26.1
TEST TYPE = CSLD
FULLEST PERIODIC TEST
PASSED EACH MONTH:
JAN 22, 2024 18:31
TEST LENGTH 31 HOURS
STARTING VOLUME = 2473
PERCENT VOLUME = 38.8
TEST TYPE = CSLD
FEB 25, 2024 4:26
TEST LENGTH 33 HOURS
STARTING VOLUME = 2259
PERCENT VOLUME = 35.4
TEST TYPE = CSLD
MAR 1, 2024 9:57
TEST LENGTH 28 HOURS
STARTING VOLUME = 2310
PERCENT VOLUME = 36.2
TEST TYPE = CSLD
APR 29, 2024 10:11
TEST LENGTH 31 HOURS
STARTING VOLUME = 1794
PERCENT VOLUME = 28.1
TEST TYPE = CSLD
MAY 29, 2024 1:55
TEST LENGTH 29 HOURS
STARTING VOLUME = 1813
PERCENT VOLUME = 28.4
TEST TYPE = CSLD
JUN 5, 2024 20:39
TEST LENGTH 26 HOURS
STARTING VOLUME = 1881
PERCENT VOLUME = 29.5
TEST TYPE = CSLD
JUL 3, 2023 22:02
TEST LENGTH 26 HOURS
STARTING VOLUME = 1891
PERCENT VOLUME = 29.7
TEST TYPE = CSLD
AUG 23, 2023 6:15
TEST LENGTH 29 HOURS
STARTING VOLUME = 1865
PERCENT VOLUME = 29.2
TEST TYPE = CSLD
SEP 19, 2023 1:59
TEST LENGTH 27 HOURS
STARTING VOLUME = 1718
PERCENT VOLUME = 26.9
TEST TYPE = CSLD
OCT 29, 2023 20:40
TEST LENGTH 32 HOURS
STARTING VOLUME = 1877
PERCENT VOLUME = 29.4
TEST TYPE = CSLD
NOV 30, 2023 5:36
TEST LENGTH 28 HOURS
STARTING VOLUME = 1909
PERCENT VOLUME = 29.9
TEST TYPE = CSLD
DEC 29, 2023 2:21
TEST LENGTH 28 HOURS
STARTING VOLUME = 2304
PERCENT VOLUME = 36.1
TEST TYPE = CSLD
***** END *****

6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:02
PRESSURE LINE LEAK TEST
RESULTS
Q 1:REGULAR
3.0 GAL/HR RESULTS:
LAST TEST:
JUN 20, 2024 8:54 PASS
NUMBER OF TESTS PASSED
PREV 24 HOURS : 131
SINCE MIDNIGHT : 28
0.20 GAL/HR RESULTS:
JUN 17, 2024 1:44 PASS
JUN 13, 2024 1:16 PASS
JUN 9, 2024 1:19 PASS
JUN 5, 2024 4:49 PASS
JUN 1, 2024 3:07 PASS
MAY 26, 2024 3:06 PASS
MAY 20, 2024 23:44 PASS
MAY 18, 2024 1:03 PASS
MAY 14, 2024 1:59 PASS
MAY 10, 2024 1:22 PASS
0.10 GAL/HR RESULTS:
JAN 13, 2024 3:02 PASS
JUN 27, 2023 3:09 PASS
DEC 25, 2022 4:18 PASS
MAY 21, 2022 2:04 PASS
NOV 10, 2021 2:15 PASS
MAY 1, 2021 0:32 PASS
OCT 22, 2020 2:28 PASS
APR 8, 2020 0:18 PASS
OCT 4, 2019 3:05 PASS
APR 1, 2019 2:04 PASS
***** END *****
GO LO
6851 BROADWAY
MERRILLVILLE IN
JUN 20, 2024 9:03
PRESSURE LINE LEAK TEST
RESULTS
Q 3:PREMIUM
3.0 GAL/HR RESULTS:
LAST TEST:
JUN 20, 2024 8:29 PASS
NUMBER OF TESTS PASSED
PREV 24 HOURS : 25
SINCE MIDNIGHT : 6
0.20 GAL/HR RESULTS:
JUN 19, 2024 11:15 PASS
JUN 15, 2024 22:28 PASS
JUN 13, 2024 6:59 PASS
JUN 9, 2024 10:09 PASS
JUN 5, 2024 19:09 PASS
JUN 3, 2024 3:14 PASS
MAY 30, 2024 21:07 PASS
MAY 26, 2024 5:18 PASS
MAY 24, 2024 23:48 PASS
MAY 22, 2024 7:28 PASS
0.10 GAL/HR RESULTS:
FEB 13, 2024 0:29 PASS
AUG 14, 2023 9:44 PASS
FEB 12, 2023 0:00 PASS
AUG 13, 2022 7:49 PASS
FEB 11, 2022 0:01 PASS
AUG 12, 2021 3:54 PASS
FEB 9, 2021 19:27 PASS
AUG 9, 2020 19:58 PASS
FEB 9, 2020 1:31 PASS
AUG 9, 2019 8:48 PASS
***** END *****

ALARM HISTORY REPORT
SYSTEM ALARM
PAPER OUT
11, 2024 12:52
PRINTING ERROR
JUN 11, 2024 12:52
***** END *****
SYSTEM SETUP
JUN 20, 2024 9:05
SYSTEM UNITS
U.S.
SYSTEM LANGUAGE
ENGLISH
SYSTEM DATE/TIME FORMAT
MON DD YYYY HH:MM:SS
GO LO
6851 BROADWAY
MERRILLVILLE IN
SHIFT TIME 1 : 6:30 AM
SHIFT TIME 2 : DISABLED
SHIFT TIME 3 : DISABLED
SHIFT TIME 4 : DISABLED
TANK PER TST NEEDED WRN
DISABLED
TANK ANN TST NEEDED WRN
DISABLED
LINE RE-ENABLE METHOD
PASS LINE TEST
LINE PER TST NEEDED WRN
DISABLED
LINE ANN TST NEEDED WRN
DISABLED
PRINT TC VOLUMES
ENABLED
TEMP COMPENSATION
VALUE (DEG F) : 60.0
STICK HEIGHT OFFSET
DISABLED
ULLAGE: 90%
H-PROTOCOL DATA FORMAT
HEIGHT
PRECISION TEST DURATION
HOURS: 12
0.20 GPH LINE TEST
AUTO-CONFIRM: ENABLED
0.10 GPH LINE TEST
AUTO-CONFIRM: ENABLED
PRINT PRECISION LINE
TEST RESULTS: ENABLED
DAYLIGHT SAVING TIME
ENABLED
START DATE
APR WEEK 1 SUN
START TIME
2:00 AM
END DATE
OCT WEEK 6 SUN
END TIME
2:00 AM
RE-DIRECT LOCAL PRINTOUT
DISABLED
EURO PROTOCOL PREFIX
S
SYSTEM SECURITY
CODE : 000000
TANK CHART SECURITY
DISABLED
CUSTOM ALARMS
DISABLED
MASS DENSITY
DISABLED

IN-TANK SETUP

T 1:REGULAR
PRODUCT CODE : 000700
THERMAL COEFF : 119.00
TANK DIAMETER : 4 PTS
TANK PROFILE : 6380
FULL VOL : 5123
89.3 INCH VOL : 3186
59.5 INCH VOL : 1257
29.8 INCH VOL :

FLOAT SIZE: 2.0 IN.

WATER WARNING : 1.5
HIGH WATER LIMIT: 2.5

MAX OR LABEL VOL: 10563
OVERFILL LIMIT : 90%
HIGH PRODUCT : 95%
DELIVERY LIMIT : 10034
DELIVERY LIMIT : 1056

LOW PRODUCT : 500
LEAK ALARM LIMIT: 99
SUDDEN LOSS LIMIT: 99
TANK TILT : 0.00
PROBE OFFSET : 0.00

SIPHON MANIFOLDED TANKS
T#: NONE
LINE MANIFOLDED TANKS
T#: 02

LEAK MIN PERIODIC: 1%
LEAK MIN ANNUAL : 105

PERIODIC TEST TYPE STANDARD
ANNUAL TEST FAIL ALARM DISABLED

PERIODIC TEST FAIL ALARM DISABLED

GROSS TEST FAIL ALARM ENABLED

ANN TEST AVERAGING: OFF
PER TEST AVERAGING: OFF

TANK TEST NOTIFY: OFF
TNK TST SIPHON BREAK:OFF

DELIVERY DELAY : 1 MIN
PUMP THRESHOLD : 10.00%

T 2:REG SLAVE

PRODUCT CODE : 000700
THERMAL COEFF : 119.00
TANK DIAMETER : 4 PTS
TANK PROFILE : 6380
FULL VOL : 5123
89.3 INCH VOL : 3186
59.5 INCH VOL : 1257
29.8 INCH VOL :

FLOAT SIZE: 4.0 IN.

WATER WARNING : 1.5
HIGH WATER LIMIT: 2.5

MAX OR LABEL VOL: 6380
OVERFILL LIMIT : 90%
HIGH PRODUCT : 95%
DELIVERY LIMIT : 6061
DELIVERY LIMIT : 638

LOW PRODUCT : 500
LEAK ALARM LIMIT: 99
SUDDEN LOSS LIMIT: 99
TANK TILT : 0.00
PROBE OFFSET : 0.00

SIPHON MANIFOLDED TANKS
T#: NONE
LINE MANIFOLDED TANKS
T#: 01

LEAK MIN PERIODIC: 1%
LEAK MIN ANNUAL : 63

PERIODIC TEST TYPE STANDARD
ANNUAL TEST FAIL ALARM DISABLED

PERIODIC TEST FAIL ALARM DISABLED

GROSS TEST FAIL ALARM ENABLED

ANN TEST AVERAGING: OFF
PER TEST AVERAGING: OFF

TANK TEST NOTIFY: OFF
TNK TST SIPHON BREAK:OFF

DELIVERY DELAY : 1 MIN
PUMP THRESHOLD : 10.00%

T 3:PREMIUM

PRODUCT CODE : 000700
THERMAL COEFF : 119.00
TANK DIAMETER : 4 PTS
TANK PROFILE : 6380
FULL VOL : 5123
89.3 INCH VOL : 3186
59.5 INCH VOL : 1257
29.8 INCH VOL :

FLOAT SIZE: 4.0 IN.

WATER WARNING : 1.5
HIGH WATER LIMIT: 2.5

MAX OR LABEL VOL: 6380
OVERFILL LIMIT : 90%
HIGH PRODUCT : 95%
DELIVERY LIMIT : 6061
DELIVERY LIMIT : 638

LOW PRODUCT : 400
LEAK ALARM LIMIT: 99
SUDDEN LOSS LIMIT: 99
TANK TILT : 0.00
PROBE OFFSET : 0.00

SIPHON MANIFOLDED TANKS
T#: NONE
LINE MANIFOLDED TANKS
T#: NONE

LEAK MIN PERIODIC: 1%
LEAK MIN ANNUAL : 63

PERIODIC TEST TYPE STANDARD
ANNUAL TEST FAIL ALARM DISABLED

PERIODIC TEST FAIL ALARM DISABLED

GROSS TEST FAIL ALARM ENABLED

ANN TEST AVERAGING: OFF
PER TEST AVERAGING: OFF

TANK TEST NOTIFY: OFF
TNK TST SIPHON BREAK:OFF

DELIVERY DELAY : 1 MIN
PUMP THRESHOLD : 10.00%

LEAK TEST METHOD

TEST CSLD : ALL TANK
Pd = 95%
CLIMATE FACTOR:MODERATE
GROSS TEST : 6380
AUTO-CONFIRM: DISABLED
REPORT ONLY:
DISABLED

TST EARLY STOP:DISABLED
LEAK TEST REPORT FORMAT NORMAL

LIQUID SENSOR SETUP
NONE

OUTPUT RELAY SETUP
R 1:REG SLAVE
TYPE: PUMP CONTROL OUTPUT
TANK #: 2

IN-TANK ALARMS
T 2:HIGH WATER ALARM

PLLD LINE DISABLE SETUP
Q 1:REGULAR
IN-TANK ALARMS
T 1:HIGH WATER ALARM

Q 3:PREMIUM
IN-TANK ALARMS
T 3:HIGH WATER ALARM
T 3:LOW PRODUCT ALARM
PRESSURE OFFSET: 0.0PSI

TRIENNIAL INSPECTION

Facility Name: Merrillville prince mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613


Test Date: 09/20/2023

SPILL CONTAINER INTEGRITY TESTING

Product	RUL S	RUL N	PUL					
Test Type	Initial	Initial	Initial					
Clean of liquid/debris	YES	YES	YES					
VISUAL INSPECTION	PASS	PASS	PASS					
Test Start Time	9:00	9:00	9:00					
Test End Time	10:00	10:00	10:00					
Starting Water Level (inches)	14	14	14					
Ending Water Level (inches)	14	14	14					
Water Level Change (inches)	0	0	0					
HYDROSTATIC TEST RESULT	PASS	PASS	PASS					
Double wall	NO	NO	NO					
Vacuum Test Length (minutes)								
Starting Inches of Water								
Ending Inches of Water								
VACUUM TEST RESULT								

Comments

Technician Name: Seamus Polanski
Dispatch # 335820
B&K Equipment completes testing and inspections per recommended practices of PEI RP1200-19

Technician Signature: 

30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville PRINCE MOBIL
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 07/12/2023
Inspection Month: July

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

ALL sumps are full to the brim with water and the middle spill buckets was full of water as well.

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 333910

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 08/02/2023
Inspection Month: August

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

South unleaded sump completely full of water still, north unleaded spill bucket completely fill with water, premium sump has a lot of water still as well.

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 335390

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 09/08/2023
Inspection Month: September

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

All sumps and all spill buckets are completely full of water. Needs to be removed.

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 336848

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 10/04/2023
Inspection Month: October

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 337977

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrelville Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 11/14/2023
Inspection Month: November

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Mark Huizenga
Dispatch # 339182

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 12/01/2023
Inspection Month: December

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments


Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 340443

Technician Signature: 

30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 01/16/2024
Inspection Month: January

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Seamus polanski
Dispatch # 341496

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: Merrillville Prince Mobil
Facility Address: 6851 Broadway, Merrillville, IN, USA
Facility ID: 22613

Inspection Date: 02/08/2024
Inspection Month: February

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours


Comments

#6 has leaking swivel, site said they had some and would replace themselves

Designed to meet EPA standards based on:

- <https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>
- https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf
- <https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 343129

Technician Signature: 

30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: PRINCE MOBIL
Facility Address: 6851 Broadway, Merrillville, IN 46410, USA
Facility ID: 22613

Inspection Date: 03/07/2024
Inspection Month: March

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Andrew Bakker
Dispatch # 400230

Technician Signature: *AB*

30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: PRINCE MOBIL
Facility Address: 6851 BROADWAY MERRILLVILLE IN 46410
Facility ID: 22613

Inspection Date: 04/05/2024
Inspection Month: April

Completed Inspection

Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection And NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>

https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

<https://sfm.illinois.gov/content/dam/soi/en/web/sfm/sfmdocuments/documents/30-day-walkthrough-inspection-report.pdf>

Technician Name: Jack Davids
Dispatch # 401142

Technician Signature:



30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: PRINCE MOBIL Test Date: 05/07/2024
 Facility Address: 6851 BROADWAY MERRILLVILLE IN 46410 May
 Facility ID: 22613

Completed Inspection


Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Double wall spill buckets inspected.	None
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection & NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>
https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

Technician Name: Jack Davids
 Dispatch # 402071

Technician Signature: 

B&K Equipment completes testing and inspections per recommended practices of PEI RP1200-19

30 DAY WALKTHROUGH INSPECTION REPORT

Facility Name: PRINCE MOBIL Test Date: 06/19/2024
 Facility Address: 6851 BROADWAY MERRILLVILLE IN 46410 June
 Facility ID: 22613

Completed Inspection


Visually check spill prevention equipment for damage, including inspecting for cracks holes or bulges.	<input checked="" type="checkbox"/>
Notify site of any liquid or debris found. Check for any potential sources of water entry, including surface water.	<input checked="" type="checkbox"/>
Check spill buckets for release of regulated substances, including in the interstices of double wall spill buckets.	<input checked="" type="checkbox"/>
Double wall spill buckets inspected.	NA
Check for any obstruction lodged in fill pipe. Remove if found. Check that fill cap fits securely on the fill pipe.	<input checked="" type="checkbox"/>
Check release detection equipment for operability. Check for any alarms or unusual operating conditions.	<input checked="" type="checkbox"/>
Print 30 day ATG report from ATG or complete log of inspection for 2-wall spill buckets. Provide copy to site to keep for inspector.	
Print and save 30 day ATG PASS reports for leak detection & NORMAL reports for sensors. Provide copy to site to keep for inspector.	<input checked="" type="checkbox"/>
Check dispensers, hoses, nozzles, & breakaways.	<input checked="" type="checkbox"/>
Check impressed current rectifier for power & operation. Enter hour, volt & amp reading on written log.	Volts Amps Hours

Comments

Designed to meet EPA standards based on:

<https://www.epa.gov/ust/underground-storage-tanks-usts-laws-and-regulations#code>
https://www.epa.gov/sites/default/files/2016-02/documents/om_final_2-17-16_508_0.pdf

Technician Name: Patrick Sons
 Dispatch # 403595

Technician Signature: 

B&K Equipment completes testing and inspections per recommended practices of PEI RP1200-19



EVIDENCE OF COMMERCIAL PROPERTY INSURANCE

DATE (MM/DD/YYYY)
04/02/2024

THIS EVIDENCE OF COMMERCIAL PROPERTY INSURANCE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE ADDITIONAL INTEREST NAMED BELOW. THIS EVIDENCE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS EVIDENCE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE ADDITIONAL INTEREST.

PRODUCER NAME, CONTACT PERSON AND ADDRESS State Farm JASON RAKOS 270 W 80TH PL MERRILLVILLE, IN 46410		PHONE (A/C, No, Ext):	COMPANY NAME AND ADDRESS State Farm Fire and Casualty Company	NAIC NO: 25143
FAX (A/C, No): 219-201-2006	E-MAIL ADDRESS: carlos.trevino.fx7x@statefarm.com		IF MULTIPLE COMPANIES, COMPLETE SEPARATE FORM FOR EACH	
CODE:	SUB CODE:	POLICY TYPE BUSINESS POLICY PROPERTY COVERAGE		
AGENCY CUSTOMER ID #:		LOAN NUMBER	POLICY NUMBER 94-AP-B845-0	
NAMED INSURED AND ADDRESS PRINCE PETRO INC 6851 BROADWAY MERRILLVILLE, IN 46410		EFFECTIVE DATE 08/07/2023	EXPIRATION DATE 08/07/2024	<input checked="" type="checkbox"/> CONTINUED UNTIL TERMINATED IF CHECKED
ADDITIONAL NAMED INSURED(S)		THIS REPLACES PRIOR EVIDENCE DATED:		

PROPERTY INFORMATION (ACORD 101 may be attached if more space is required) BUILDING OR BUSINESS PERSONAL PROPERTY

LOCATION / DESCRIPTION
6851 BROADWAY
MERRILLVILLE, IN 46410


THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS EVIDENCE OF PROPERTY INSURANCE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

COVERAGE INFORMATION	PERILS INSURED	BASIC	BROAD	<input checked="" type="checkbox"/> SPECIAL	DED:
COMMERCIAL PROPERTY COVERAGE AMOUNT OF INSURANCE:	\$ 1,000,000				DED: 2,500
<input checked="" type="checkbox"/> BUSINESS INCOME <input type="checkbox"/> RENTAL VALUE		YES NO N/A			Actual Loss Sustained; # of months:
BLANKET COVERAGE		<input checked="" type="checkbox"/>			If YES, indicate value(s) reported on property identified above: \$
TERRORISM COVERAGE		<input checked="" type="checkbox"/>			Attach Disclosure Notice / DEC
IS THERE A TERRORISM-SPECIFIC EXCLUSION?		<input checked="" type="checkbox"/>			
IS DOMESTIC TERRORISM EXCLUDED?		<input checked="" type="checkbox"/>			
LIMITED FUNGUS COVERAGE		<input checked="" type="checkbox"/>			If YES, LIMIT: DED:
FUNGUS EXCLUSION (If "YES", specify organization's form used)		<input checked="" type="checkbox"/>			
REPLACEMENT COST		<input checked="" type="checkbox"/>			
AGREED VALUE		<input checked="" type="checkbox"/>			
COINSURANCE			<input checked="" type="checkbox"/>		If YES, %
EQUIPMENT BREAKDOWN (If Applicable)					If YES, LIMIT: DED:
ORDINANCE OR LAW - Coverage for loss to undamaged portion of bldg		<input checked="" type="checkbox"/>			If YES, LIMIT: DED:
- Demolition Costs		<input checked="" type="checkbox"/>			If YES, LIMIT: DED: 2,500
- Incr. Cost of Construction		<input checked="" type="checkbox"/>			If YES, LIMIT: DED: 2,500
EARTH MOVEMENT (If Applicable)			<input checked="" type="checkbox"/>		If YES, LIMIT: DED:
FLOOD (If Applicable)			<input checked="" type="checkbox"/>		If YES, LIMIT: DED:
WIND / HAIL INCL <input type="checkbox"/> YES <input type="checkbox"/> NO Subject to Different Provisions:		<input checked="" type="checkbox"/>			If YES, LIMIT: DED:
NAMED STORM INCL <input type="checkbox"/> YES <input type="checkbox"/> NO Subject to Different Provisions:		<input checked="" type="checkbox"/>			If YES, LIMIT: DED:
PERMISSION TO WAIVE SUBROGATION IN FAVOR OF MORTGAGE HOLDER PRIOR TO LOSS		<input checked="" type="checkbox"/>			

CANCELLATION

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.

ADDITIONAL INTEREST

<input type="checkbox"/> CONTRACT OF SALE <input type="checkbox"/> MORTGAGEE	<input type="checkbox"/> LENDER'S LOSS PAYABLE <input type="checkbox"/> LOSS PAYEE	LENDER SERVICING AGENT NAME AND ADDRESS JASON RAKOS STATE FARM 270 W 80TH PL MERRILLVILLE, IN 46410
NAME AND ADDRESS		AUTHORIZED REPRESENTATIVE 

© 2003-2015 ACORD CORPORATION. All rights reserved.

AGENCY CUSTOMER ID: _____
 LOC #: _____



ADDITIONAL REMARKS SCHEDULE

AGENCY JASON RAKOS STATE FARM		NAMED INSURED PRINCE PETRO INC	
POLICY NUMBER 94-AP-B845-0		6851 BROADWAY MERRILLVILLE, IN 46410	
CARRIER State Farm Fire and Casualty Company	NAIC CODE 25178	EFFECTIVE DATE: 08/07/2023	

ADDITIONAL REMARKS

THIS ADDITIONAL REMARKS FORM IS A SCHEDULE TO ACORD FORM.
 FORM NUMBER: 25178 FORM TITLE: EVIDENCE OF COMMERCIAL PROPERTY INSURANCE

Dwelling Coverage A	1,000,000
Fuel and Oil Storage/Dispensing Equipment Included in Coverage A	
Underground Fuel or Oil Storage Tanks	
Business Property Coverage B	135,700
Loss of Income and Extra Expense	12 Months Actual Loss Sustained
Business Liability	1,000,000
Medical Expenses Coverage M	5,000 Any One Person
Damages to Premises Rented to You	300,000
Aggregate Limits	
General Aggregate	2,000,000
Products/Complete Operations Aggregate	2,000,000
Coverage of Perils Include: Wind and Hail coverage	

Insureds
 PRINCE PETRO INC
 GODFATHER S PIZZA INC ITS SUBSIDIARY COMPANIES DIRECTORS OFFICERS EMPLOYEES
 PRINCE PETROLEUM INC

CERTIFICATE OF COMPLETION

This is to certify that

Andrew Bakker

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
03/21/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Ben Olthoff

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
07/02/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Benjamin Porter

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
02/13/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION


This is to certify that

Blake Zylstra

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
03/17/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Brandon Huizenga

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
06/21/2022



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Brent Fox

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
04/26/2022



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Daniel Groen

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
03/28/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION


This is to certify that

Derek Terpetra

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
04/04/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Darren White

has successfully completed the online course

Illinois Class A/B UST Operator Training

on
03/16/2023



Ben Thomas
Ben Thomas
Continuing.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 361-6263 3493 Daisy Lane, Clinton, WA 98226 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Ed Angell
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
03/24/2023



Continuing com. Approval Status

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Jack Davids
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
05/11/2023



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Joshua Scheeringa
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
04/03/2023



Continuing com. Approval Status

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Kyle Vandermeiden
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
11/16/2022



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Luke Hulzenga
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
04/11/2022



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Mark Hulzenga
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
03/31/2023



Continuing com. Approval Status

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Michael Terpetra
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
04/10/2023



Continuing com. Approval Status


This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Patrick Sons
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
04/10/2023



Continuing com. Approval Status

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Richard Porter
has successfully completed the online course
Illinois Class A/B UST Operator Training
on
04/10/2023



Continuing com. Approval Status

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 5483 Dairy Lane, Closter, WA 98258 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Ricky Voss

has successfully completed the online course

Illinois Class A/B UST Operator Training

03/15/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION


This is to certify that

Robert Pauls

has successfully completed the online course

Illinois Class A/B UST Operator Training

03/17/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION


This is to certify that

Seamus Polanski

has successfully completed the online course

Illinois Class A/B UST Operator Training

02/13/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION


This is to certify that

Stanton Hulzenga

has successfully completed the online course

Illinois Class A/B UST Operator Training

04/07/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Steve Hulzenga

has successfully completed the online course

Illinois Class A/B UST Operator Training

03/14/2023



This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Timothy George

has successfully completed the online course

Illinois Class A/B UST Operator Training

03/24/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

CERTIFICATE OF COMPLETION

This is to certify that

Timothy Hulzenga

has successfully completed the online course

Illinois Class A/B UST Operator Training

04/10/2023



Ben Thomas
Ben Thomas
UST Training.com Approved Trainer

This certificate is valid for four years from the date of issue unless directed by the Illinois Office of the State Fire Marshal to refresh due to operational violations.

© USTTraining.com (866) 301-8263 3493 Dairy Lane, Clinton, WA 98216 This certificate has been generated digitally.

JMM Management Group, LLC

presents

UST Operator Training

to

guriqbal singh

for

*Successfully completing
Illinois Class C Underground Storage Tank Training
requirements for the State of Illinois*

Training completed on: 4/15/2024

Expires on: 4/14/2028



JMM Management Group, LLC
2496 Technology Drive
Elgin, IL 60124
(847)888-0276
www.jmmglobal.com

Certificate #: 3415996

www.MyOperatorTraining.com